

# All-Island Transmission System Performance Report 2022

April 2023



Revision History		
Revision	Date	Description
R0	28/04/23	Original issue
R1	18/07/23	Correction to typos in Table 3

COPYRIGHT © EirGrid

All rights reserved. No part of this work may be modified or reproduced or copied in any form or by means - graphic, electronic or mechanical, including photocopying, recording, taping or information and retrieval system, or used for any purpose other than its designated purpose, without the written permission of EirGrid

# Contents

<b>1. Introduction</b>	<b>10</b>
<b>2. Executive Summary</b>	<b>11</b>
2.1. Key Data .....	11
<b>3. All-Island System Data</b>	<b>12</b>
3.1. Overview of the All-Island Electricity System .....	12
3.2. Total System Production.....	12
3.3. System Records .....	13
3.4. Generation Capacity .....	14
3.5. Generation Availability .....	15
3.6. Generation Forced Outage %.....	16
3.7. Generation Scheduled Outage %.....	17
3.8. DSU Availability .....	18
<b>4. EirGrid Transmission System Performance</b>	<b>19</b>
4.1. Summary .....	19
4.2. Grid Development and Maintenance .....	19
4.2.1. Completed Capital Projects .....	19
4.2.2. New Connection Offers .....	20
4.2.3. Connections Energised .....	21
4.2.4. Customers Certified Operational .....	21
4.3. General System Performance .....	23
4.3.1. Under-Frequency Load Shedding .....	23
4.3.2. Under-Voltage Load Shedding.....	24
4.4. System Minutes Lost.....	25
4.5. Zone Clearance Ratio .....	26
4.5.1. Frequency Control .....	26

4.6.	Summary of key disturbances .....	27
4.6.1.	Loss of load .....	27
4.6.2.	Under-Frequency Load Shedding .....	27
4.6.3.	Storms Resulting in Trippings .....	27
4.7.	Transmission System Availability & Outages .....	28
4.7.1.	Transmission System Availability .....	28
4.7.2.	Transmission Plant Availability .....	29
4.7.3.	Cause of Transmission Plant Unavailability .....	30
4.7.4.	110 kV Circuit Unavailability .....	30
4.7.5.	220 kV Circuit Unavailability .....	31
4.7.6.	275 kV Circuit Unavailability .....	32
4.7.7.	400 kV Circuit Unavailability .....	33
4.7.8.	East West Interconnector .....	34
4.7.9.	East West Interconnector Unavailability .....	34
4.7.10.	Transmission Outage Duration .....	35
4.7.11.	Timing of Transmission Outages .....	35
4.7.12.	Forced Outages.....	37
4.7.13.	Forced Outages per km .....	37
4.7.14.	Forced Outages per MVA.....	38

## **5. SONI Transmission System Performance 39**

5.1.	Summary .....	39
5.2.	Transmission System Availability .....	40
5.2.1.	System Availability .....	40
5.2.2.	System Unavailability .....	41
5.2.3.	System Historical Availability Performance .....	42

5.2.4.	System Historical Unavailability Performance .....	43
5.2.5.	Moyle Interconnector .....	44
5.2.6.	Moyle Interconnector Historical Availability .....	44
5.2.7.	Moyle Interconnector Historical Unavailability .....	45
5.2.8.	Moyle Interconnector Monthly Unavailability .....	46
5.2.9.	275 kV Tie Line .....	46
5.2.10.	110 kV Tie lines .....	47
5.3.	Transmission System Security .....	49
5.3.1.	Incidents for 2022 .....	49
5.3.2.	Number of Incidents and Estimated Unsupplied Energy .....	49
5.3.3.	Incident Analysis .....	49
5.3.4.	Unsupplied Energy .....	50
5.3.5.	System minutes lost .....	51
5.3.6.	Zone Clearance Ratio .....	51
5.4.	Quality of Service .....	52
5.4.1.	Voltage .....	52
5.4.2.	Voltage Excursions .....	52
5.4.3.	Frequency .....	52
5.4.4.	Frequency Excursions .....	53
5.4.5.	Historical Frequency Excursions .....	53

## **6. Appendix 1 Glossary 54**

6.1.	DCEF .....	54
6.2.	Disturbance .....	54
6.3.	Fault .....	54
6.4.	Main system: EirGrid .....	54

6.5. Main system: SONI .....	55
6.6. Major incident.....	55
6.7. MVA Minute Lost .....	55
6.8. Non main system/outside the main system: EirGrid.....	55
6.9. Non main system/outside the main system: SONI.....	55
6.10. Non-System Fault .....	56
6.11. Permanent Fault .....	56
6.12. POTT.....	56
6.13. Protection - Correct Operation .....	56
6.14. Protection - Incorrect Operation .....	56
6.15. PUTT.....	57
6.16. Sustained Interruption .....	57
6.17. System Fault.....	57
6.18. System Minute.....	57
6.19. Transient Fault.....	57
6.20. Zone Clearance Ratio .....	58
6.21. Zones of Protection .....	58
<b>7. Appendix 2 All Island Dispatchable Generation Plant</b>	<b>60</b>
<b>8. Appendix 3 EirGrid Maintenance Policy Terms</b>	<b>67</b>
<b>9. Appendix 4 Formulae</b>	<b>68</b>
9.1. Ireland Availability & Unavailability Formula.....	68
9.2. System Minute Formula .....	69

## List of Figures

Figure 1: All-Island Dispatchable Conventional Generator (including AGUs) Availability 2022 .....	15
Figure 2: All-Island Dispatchable Conventional Generator (including AGUs) Forced Outage % 2022 .....	16
Figure 3: All-Island Dispatchable Conventional Generator (including AGUs) Scheduled Outage Rate 2022 .	17
Figure 4: All-Island DSU Availability 2022 .....	18
Figure 5: Under frequency disturbances 2013-2022.....	23
Figure 6: Lowest system frequency 2013-2022 .....	24
Figure 7: System minutes lost and associated targets: EirGrid 2013-2022.....	25
Figure 8: Zone clearance ratio: EirGrid 2013-2022.....	26
Figure 9: Monthly Variations of Transmission System Unavailability 2022 .....	28
Figure 10: Causes of Unavailability on the 110 kV System in 2022 .....	31
Figure 11: Causes of Unavailability on the 220 kV System in 2022.....	32
Figure 12: Causes of Unavailability on the 400kV System in 2022 .....	33
Figure 13: Duration of Outages in 2021 & 2022.....	35
Figure 14: Percentage unavailability in each month of 2021 & 2022 .....	36
Figure 15: Average duration of outages 2021 & 2022 .....	36
Figure 16: Forced Outages of lines and cables per km in 2022.....	37
Figure 17: Forced Outage per MVA in 2022.....	38
Figure 18: Transmission System Availability 2022 .....	41
Figure 19: Transmission System Unavailability 2022 .....	42
Figure 20: Historical System Availability 2013 to 2022 .....	43
Figure 21: Historical System Unavailability 2013 to 2022 .....	43
Figure 22: Historical Moyle Interconnector Availability 2013 to 2022 .....	45

Figure 23: Historical Moyle Interconnector Unavailability 2013 to 2022 ..... 45

Figure 24: Moyle Interconnector Monthly Unavailability 2022 ..... 46

Figure 25: Historical North-South Tie Line Availability 2022 ..... 47

Figure 26: North-South Tie Line Availability 2013 to 2022 ..... 48

Figure 27: 110kV Tie Line Unavailability 2022 ..... 48

Figure 28: Historical System Security 2013 to 2022 ..... 50

Figure 29: Historical Unsupplied Energy 2013 to 2022 ..... 50

Figure 30: System minutes lost 2013 - 2022 ..... 51

Figure 31: Historic Frequency Excursions 2013-2022 ..... 53

Figure 32: Zones of Protection ..... 58

## List of Tables

Table 1: Total Exported Energy 2012 - 2022 .....	13
Table 2: System Records 2020 - 2022 .....	13
Table 3: New Capacity Executed Demand & Generation Connection Agreements .....	20
Table 4: Demand & Generation Transmission Connections Energised in 2022 .....	21
Table 5: Customers Certified Operational in 2022 .....	22
Table 6: Transmission System Plant Availability 2022 .....	29
Table 7: Transmission System Plant Unavailability Categories .....	30
Table 8: Transmission System Plant Outage 2022 .....	34
Table 9: Voltage step change limits in operational timescales .....	52
Table 10: All Island Dispatchable Generation Plant.....	60

# 1. Introduction

EirGrid and SONI, as Transmission System Operators (TSOs) for Ireland and Northern Ireland respectively, are pleased to present the annual Transmission System Performance Report for 2022. This report contains transmission system data and performance statistics for the transmission system in Ireland and Northern Ireland for the year 2022 (1 January 2022 - 31 December 2022).

EirGrid is required to publish an annual report on the performance of the TSO business in accordance with Condition 18 of the Transmission System Operator Licence granted to EirGrid by the Commission for Regulation of Utilities (CRU).

Similarly, SONI is required to produce an annual report on the performance of the TSO business in accordance with Condition 20 of the Licence to participate in the Transmission of Electricity granted to SONI Ltd by the Department for the Economy.

This report contains high-level transmission system characteristics and a detailed breakdown of key figures along with an explanation of what these figures mean for the all-island transmission system in the coming year and into the future. Through comparison with previous reports, this report provides a useful resource through which possible trends can be identified.

This report is structured as follows:

- Section 3 outlines all-island system data, generation availability and outages,
- Section 4 details the performance of the EirGrid TSO business during 2022 against the criteria approved by the CRU,
- Section 5 details the performance of the SONI TSO business during 2022 against the criteria approved by The Utility Regulator in Northern Ireland.

Appendices which provide further detail on the data, results and methodology of relevance are included at the end of this report.

## 2. Executive Summary

The annual Transmission System Performance Report for 2022 is a comprehensive review of the transmission system through which EirGrid and SONI make available key all-island system operating data from the previous year.

Key statistics detailed in this report include:

- All-Island Generation Statistics
- Transmission System Availability Statistics for Ireland and Northern Ireland
- Details on System Events leading to System Minutes Lost
- Details of All-Island System Frequency Events

### 2.1. Key Data

#### *All-island*

- All-island peak demand reached 7,031 MW on 14 December 2022 at 17:26. The minimum all-island demand was 2,887 MW and occurred on 26 June 2022 at 05:29.
- The all-island installed capacity of conventional generation in 2022 was 8,243 MW.
- In 2022 the system frequency was operated within 49.9 Hz and 50.1 Hz for 98.52% of the time.

#### *Ireland*

- In 2022 the availability of the East West Interconnector was 82.70%.
- The weighted-average availability of the Ireland transmission system in 2022 was 95.99%.
- The System Minutes Lost for 2022, attributable to EirGrid, was 0.132.

#### *Northern Ireland*

- The availability of the Moyle Interconnector for 2022 was 79.48%.
- The average availability of the Northern Ireland transmission system in 2022 was 97.60%.
- The System Minutes Lost for 2022, attributable to SONI, was 0.021.

# 3. All-Island System Data

## 3.1. Overview of the All-Island Electricity System

The transmission system in Ireland and Northern Ireland provides the means to transport energy from generators to demand centres across the island. The transmission system is comprised of high-voltage overhead lines and cables that connect power stations, interconnectors and substations. Transformers link different voltage levels and provide a path for power to flow, typically, from higher to lower voltage networks. The transmission system in Ireland is operated at 400 kV, 220 kV and 110 kV. The transmission system in Northern Ireland is operated at 275 kV and 110 kV.

The 400 kV, 275 kV and 220 kV networks form the backbone of the transmission system. They have higher power carrying capacity and lower losses than the 110 kV networks.

The Ireland and Northern Ireland transmission systems are electrically connected by means of one 275 kV double-circuit. This connection is from Louth station in Co. Louth (IE) to Tandragee station in Co. Armagh (NI).

There are also two 110 kV connections:

- Letterkenny station in Co. Donegal (IE) to Strabane station in Co. Tyrone (NI)
- Corraclassy station in Co. Cavan (IE) to Enniskillen station in Co. Fermanagh (NI)

This section contains basic all-island transmission system data. Further information can be found on the EirGrid Group website: [www.eirgridgroup.com](http://www.eirgridgroup.com).

## 3.2. Total System Production

Total exported energy takes into account energy supplied by large-scale and some small-scale generation<sup>1</sup> as well as pumped storage units on the island. This does not take into account interconnector imports and exports.

---

<sup>1</sup> Small-scale generation that is modelled in our Energy Management System, typically  $\geq 5$  MW.

Table 1: Total Exported Energy 2012 - 2022

	2020	2021	2022 <sup>2</sup>
All-Island Total Exported Energy [GWh]	39,189	38,479	41,026
Ireland Total Exported Energy [GWh]	30,738	30,123	32,308
Northern Ireland Total Exported Energy [GWh]	8,451	8,356	8,718

### 3.3. System Records

Peak demand is a measure of the maximum demand on the transmission system over a particular period (e.g., annual or seasonal) and is a key measurement for any power system. The transmission system in Ireland and Northern Ireland is a winter peaking system as a result of greater heating and lighting requirements during the winter months. The all-island winter peak in 2022 was 7,031 MW and occurred at 17:26 on 14 December.

In summer, the reduced need for heating and lighting results in a lower demand for electricity. The minimum demand is known as the ‘minimum summer night valley’ and in 2022 a minimum all-island demand of 2,887 MW was recorded at 05:29 on 26 June.

From the installed wind capacity, a peak all-island wind generation output of 4,610 MW was achieved on at 13:11 on 5 February 2022. Table 2 provides a summary of the system records for years 2020 - 2022.

Table 2: System Records 2020 - 2022

	2020	2021	2022
Winter Peak Demand [MW]	6,904	6,826	7,031
Minimum Summer Night Valley [MW]	2,395	2,765	2,887
Maximum Wind Generation [MW]	4,246	4,489	4,610

---

<sup>2</sup> Provisional figures for 2022

## 3.4. Generation Capacity

Generating plant is connected to both the transmission and distribution systems. All generation contributes to meeting system demand. The total generation capacity is calculated as the sum of all fully operational generator capacities connected to both systems.

The all-island installed capacity of conventional dispatchable generation on 31 December 2022 was 8,243 MW (6,295 MW in Ireland and 1,865 MW in Northern Ireland including 83 MW of Aggregated Generator Units (AGUs)).

The capacity of demand side units (DSUs) was 641 MW in Ireland and 112 MW in Northern Ireland, with an average availability of 23 %. This does not include any import capacity from the Moyle Interconnector or the East West Interconnector.

The all-island installed capacity of wind generation on 31 December 2022 was 5,878 MW (4,527 MW in Ireland and 1,351 MW in Northern Ireland).

Appendix 2 provides a list of the fully dispatchable generating units connected to the power system.

### 3.5. Generation Availability

Generation Availability is a measure of the capability of a generator to deliver power in a given period to the transmission system. In order for EirGrid and SONI to operate a secure and reliable transmission system in an economic and efficient manner, it is necessary for generators to maintain a high rate of availability.

Generation system availability is calculated on a daily and 365-day rolling average basis<sup>3</sup>. Figure 1 shows the daily and 365-day rolling average availability for 2022.

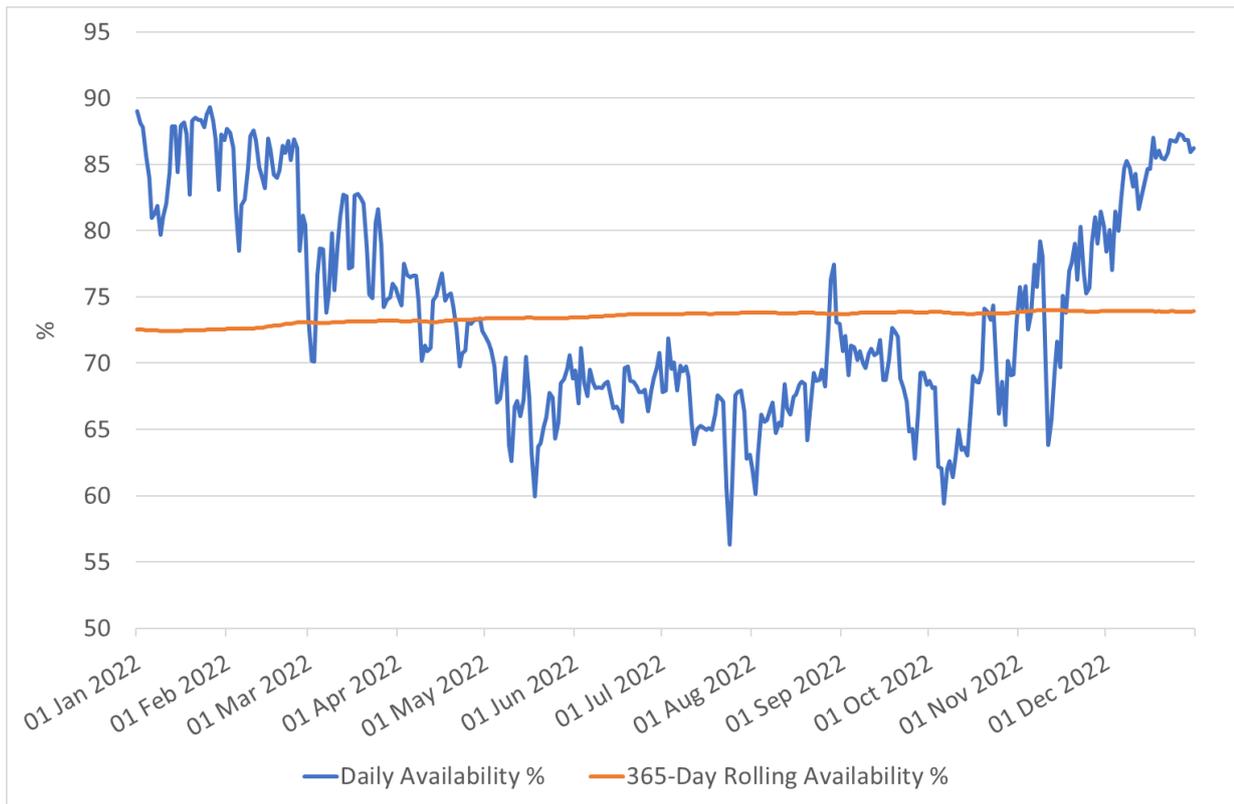


Figure 1: All-Island Dispatchable Conventional Generator (including AGUs) Availability 2022

The average daily generation system availability in 2022 was 73.9%.

The maximum daily generation system availability in 2022 was 89.3%.

The minimum daily generation system availability in 2022 was 56.3%.

<sup>3</sup> 365-day rolling average is a capacity weighted average availability over the previous 365 days.

### 3.6. Generation Forced Outage %

The generation forced outage % is calculated on a daily and rolling 365-day average basis. The daily forced outage % is a capacity weighted percentage of the time during the day that generation units are unavailable due to unforeseen/unplanned outages. The 365-day rolling forced outage % is the average of the daily forced outage % over the previous 365 days. The daily forced outage % and 365-day rolling forced outage % are shown in Figure 2.

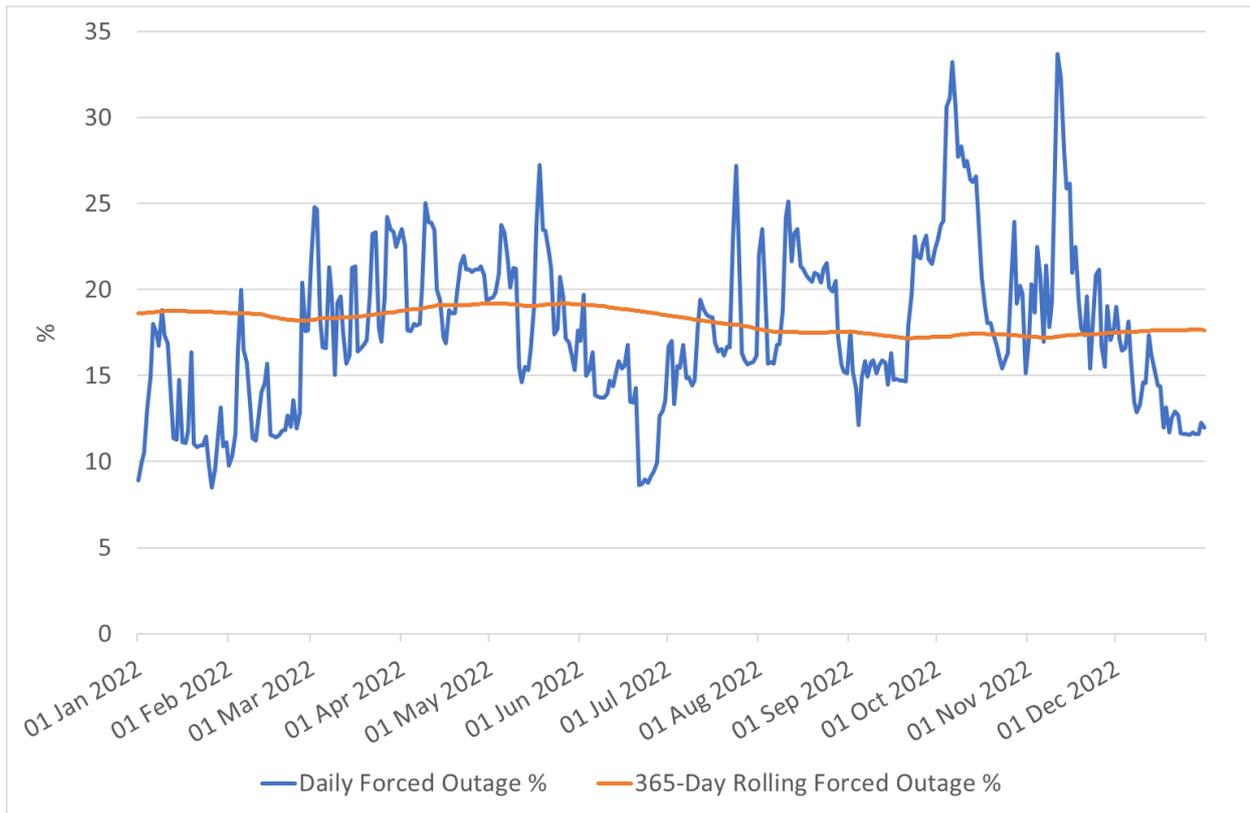


Figure 2: All-Island Dispatchable Conventional Generator (including AGUs) Forced Outage % 2022

The average daily generation system forced outage rate in 2022 was 17.6%.

The maximum daily generation system forced outage rate in 2022 was 33.7%.

The minimum daily generation system forced outage rate in 2022 was 8.5%.

### 3.7. Generation Scheduled Outage %

The generation scheduled outage % can be calculated on a daily and rolling 365-day average basis. The daily scheduled outage % is a capacity weighted percentage of the time during the day that generation units are unavailable due to planned outages. The 365-day rolling scheduled outage % is the average of the daily scheduled outage % over the previous 365 days. The daily scheduled outage % and 365-day rolling scheduled outage % are shown in Figure 3.

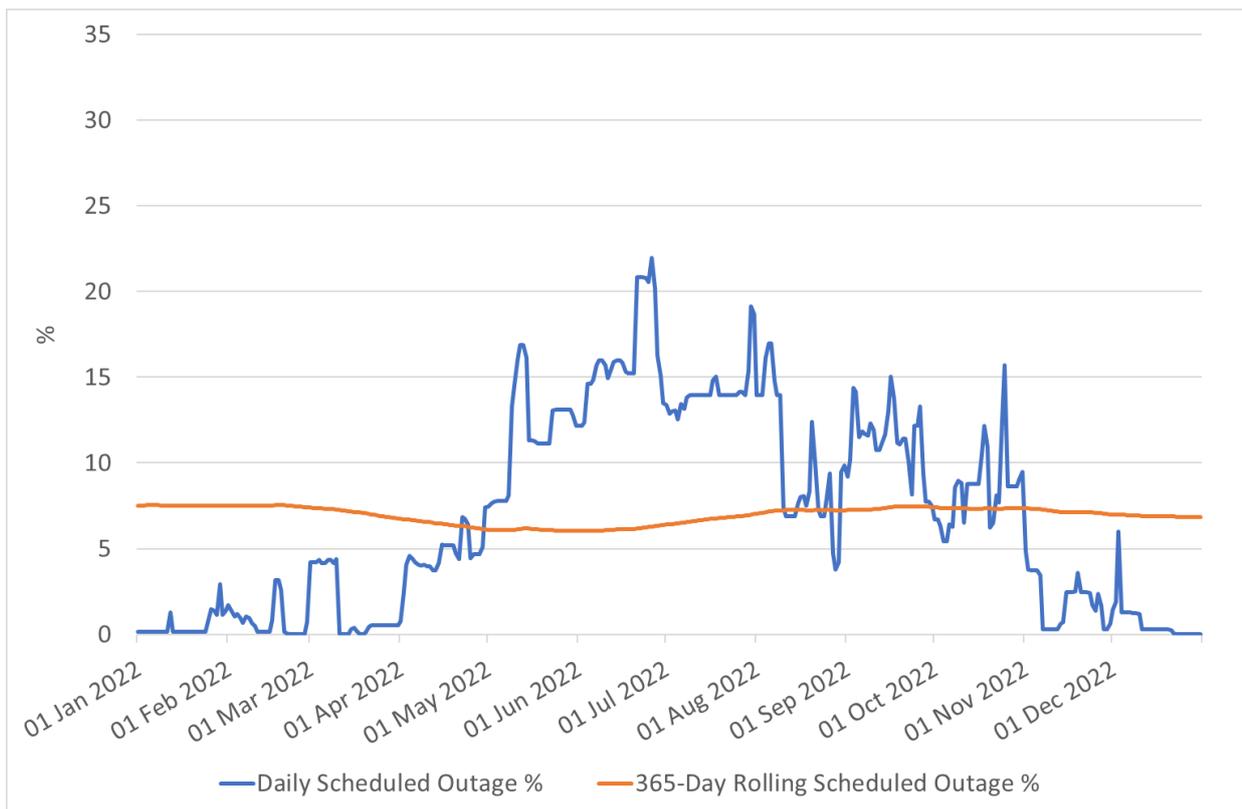


Figure 3: All-Island Dispatchable Conventional Generator (including AGUs) Scheduled Outage Rate 2022

The average daily generation system scheduled outage rate in 2022 was 6.8%.

The maximum daily generation system scheduled outage rate in 2022 was 22.0%.

The minimum daily generation system scheduled outage rate in 2022 was 0%.

### 3.8. DSU Availability

DSU Availability is a measure of the capability of a Demand Side Unit to deliver demand reduction in a given period to the transmission system. In order for EirGrid and SONI to operate a secure and reliable transmission system in an economic and efficient manner, it is necessary for DSUs to maintain a high rate of availability.

DSU system availability is calculated on a daily and 365-day rolling average basis<sup>4</sup>. Figure 4 shows the daily and 365-day rolling average availability for 2022.

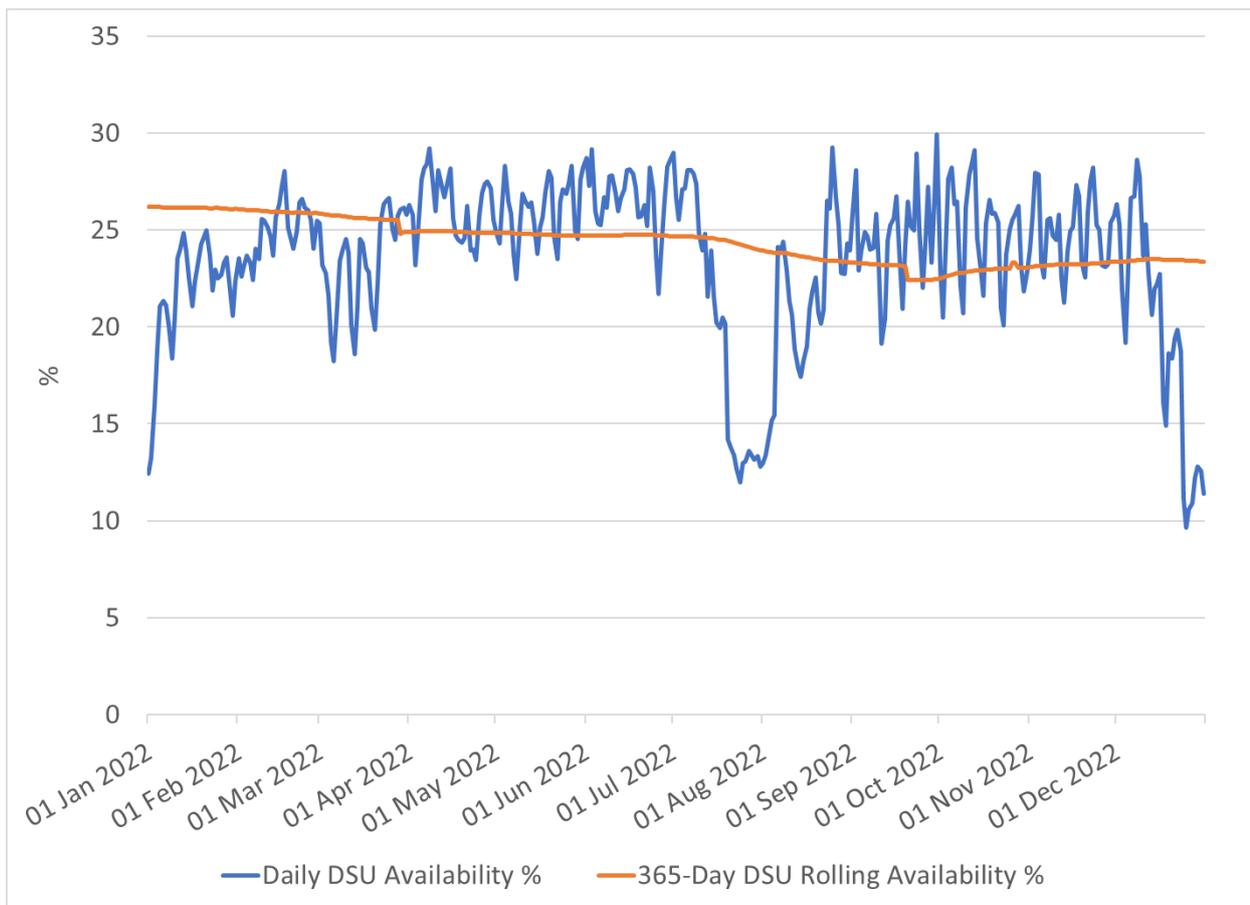


Figure 4: All-Island DSU Availability 2022

<sup>4</sup> 365-day rolling average is a capacity weighted average availability over the previous 365 days.

# 4. EirGrid Transmission System Performance

This section relates to the performance of EirGrid TSO and the transmission system in Ireland only, unless explicitly stated otherwise. This data has been prepared by EirGrid in accordance with the requirements of Part 5 of Condition 18 of its Transmission System Operator Licence.

## 4.1. Summary

There were no major incidents in 2022. A major incident is one which results in the loss of greater than or equal to one system minute as a result of a single system disturbance.

The system minutes lost as a result of faults on the main system was 0.132 in 2022. No system minutes were lost due to the disconnection of normal tariff load customers during Under Frequency Load Shedding (UFLS) disturbances.

EirGrid have a target to operate the system frequency within the range 49.9 Hz to 50.1 Hz for 98% of the time. In 2022, the system frequency was within the agreed limits 98.52% of the time.

## 4.2. Grid Development and Maintenance

This section provides an overview of grid development activities in 2022.

### 4.2.1. Completed Capital Projects

- Kilpaddoge 220/110kV station
- Kilpaddoge - Knockanure 220 kV cable
- Castlebar 110 kV station busbar uprate
- Binbane 110 kV Station - Gate 3 DSO wind generation
- Ballyvouskill - Knockanure 220kV line uprate
- Great Island - Kilkenny 110 kV uprate
- Croaghonagh 110 kV station
- Bandon 110 kV station - Protection works
- Rosspile 110 kV station
- Gallanstown 110 kV station
- Mullagharlin 110 kV station - 2 new DSO transformer bays
- Cloncreen 110 kV station

- Cloghan Wind Farm- New 110 kV transformer bay
- Cloghran Phase 2 transformer replacement
- Aghada BESS 01
- Porterstown BESS
- Golagh BESS

#### 4.2.2. New Connection Offers

Parties seeking a new connection to the transmission system must apply to EirGrid for a connection offer. EirGrid operates within a regulatory approved process for providing connection offers to generators and demand customers seeking direct connection to the transmission system. The process for issuing generation offers was consulted on in 2017 resulting in the Enduring Connection Policy (ECP) which has led to a significant increase in the number of new generation capacity offers issued between 2019 and 2022. Applications for ECP-2.3 opened in September 2022 and will begin to be processed in Q2 2023.

In order to connect to the transmission system, all demand and generation customers must execute a connection agreement with EirGrid. Table 3: New Capacity Executed Demand & Generation Connection Agreements summarises the total number of new capacity connection agreements executed in 2022 and their associated load or generation capacities. A connection offer which is accepted in one year is unlikely to impact on connected generation capacity in the same year given the lead times associated with construction.

*Table 3: New Capacity Executed Demand & Generation Connection Agreements*

	Demand	Generation	Autoproducer	Interconnector
Executed Connection Agreements in 2022 [No.]	0	17	0	0
Executed Connection Agreements in 2022 [Capacity]	0.00 MVA	1470.46 MW	0.00 MW MEC 0.00 MVA MIC	0 MW

In addition to issuing connection offers for new generation and demand capacity, EirGrid facilitates existing contracted customers in modifying existing connection agreements.

### 4.2.3. Connections Energised

When a connection agreement is executed for a new connection, it typically takes a number of years before the demand or generation is connected to the transmission system. This period includes project development, time taken to obtain consents and to construct the connection.

When the transmission connection is energised, it then takes a number of months for the generator to reach commercial operation. This period is generally much shorter for demand customers.

Table 4: Demand & Generation Transmission Connections Energised in 2022 provides an overview of the number of new connections to the transmission system commissioned in 2022.

*Table 4: Demand & Generation Transmission Connections Energised in 2022*

	Demand	Conventional Generation	PPM <sup>5</sup>	Battery
Connections Energised in 2022 [No.]	5	0	8	2
Connections Energised in 2022 [Capacity]	285 MVA	0 MW	620 MW	33 MW

### 4.2.4. Customers Certified Operational

provides an overview of customers connected to the transmission system who have been deemed fully operational. It shows customer connections which have completed the testing phase and have received an operational certificate from EirGrid. This includes generators connected to the distribution network. Note that demand customers are not currently certified by EirGrid and are therefore not included in the table.

Following energisation, the unit is required to complete Grid Code Compliance testing, following which Operational Certificates<sup>6</sup> are issued.

---

<sup>5</sup> PPM: Power Park Modules.

<sup>6</sup> EirGrid issues Operational Certificate Justifications for distribution-connected generation. These are the included in the figures shown.

Table 5: Customers Certified Operational in 2022

	Total number of new units certified operational in 2022	Total new capacity certified operational in 2022
PPM	8	189.1 MW
Conventional	0	0 MW
Battery	2	17.5 MW
DSU including existing with change in capacity	19	84.2 MW

## 4.3. General System Performance

### 4.3.1. Under-Frequency Load Shedding

There were no UFLS disturbances in 2022 which resulted in shedding of normal tariff load customers.

The relays to disconnect normal tariff customer load are only activated once the system frequency drops to 48.85 Hz. The lowest system frequency in 2022 was 49.65 Hz.

Figure 5 provides a trend of the number of disturbances since 2013 that involved operation of under-frequency relays to disconnect interruptible and normal tariff end-users. No normal tariff customers have been disconnected due to an under-frequency disturbance since 2014.

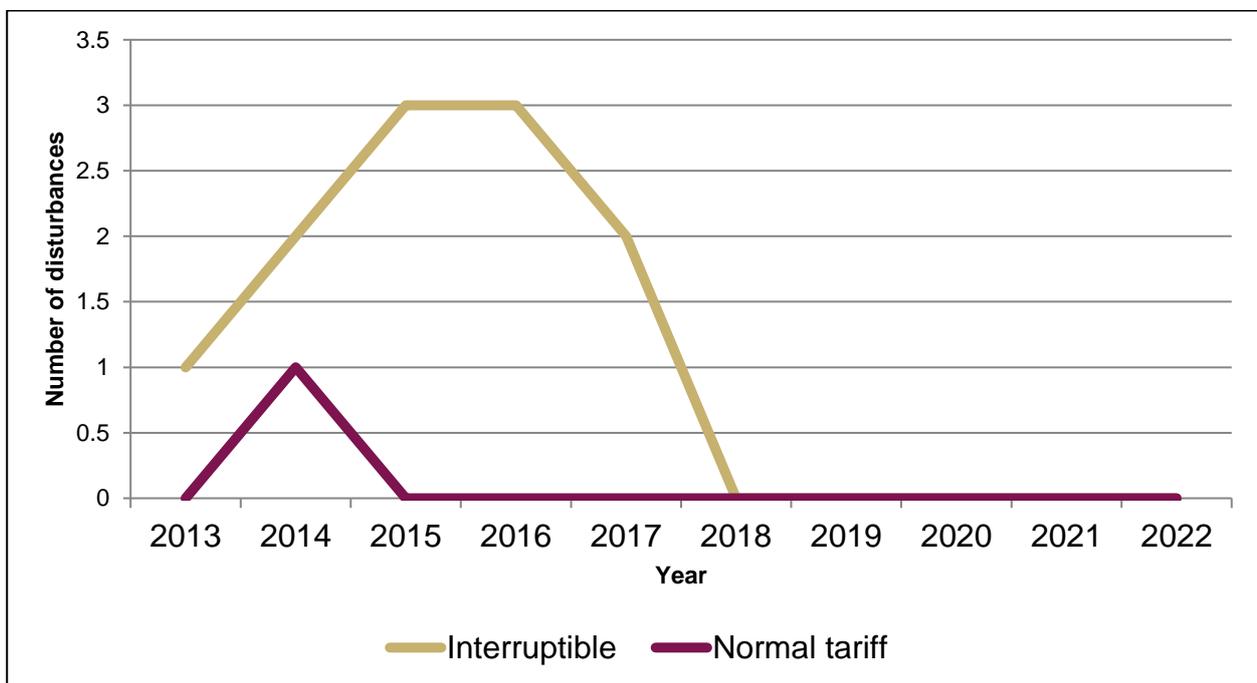


Figure 5: Under frequency disturbances 2013-2022

Figure 6 provides a trend of the lowest system frequency by year since 2013.

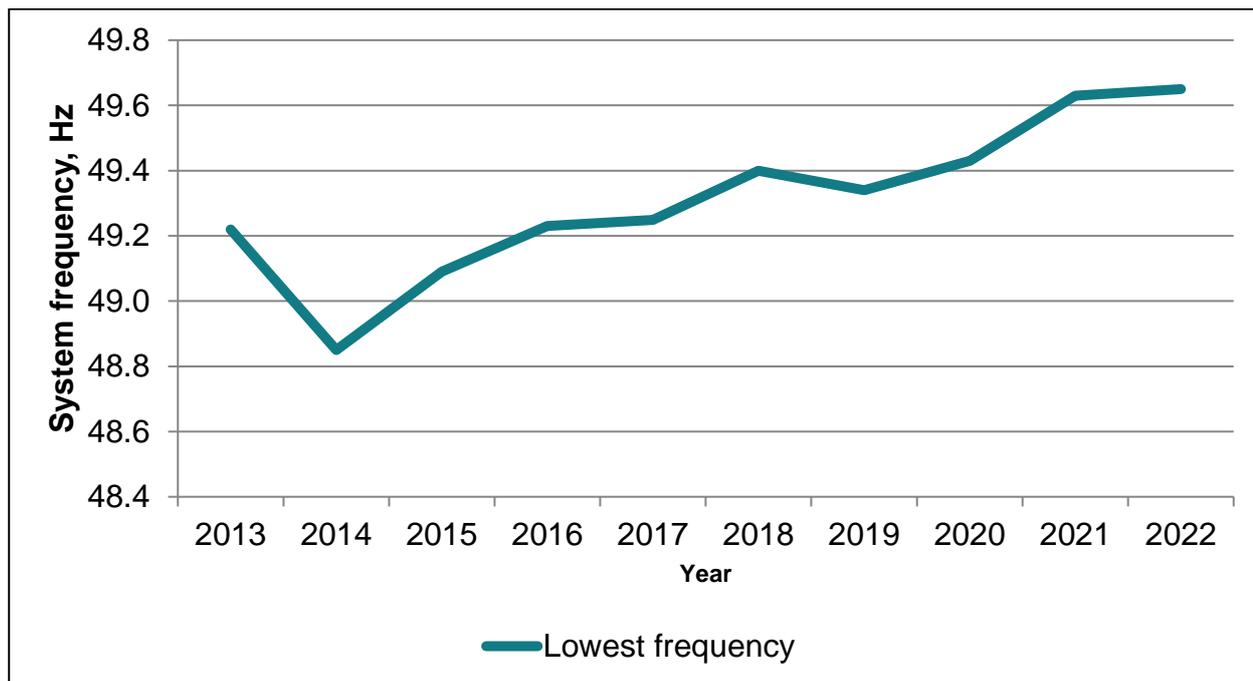


Figure 6: Lowest system frequency 2013-2022

#### 4.3.2. Under-Voltage Load Shedding

There was no incident of Under-Voltage Load Shedding in 2022.

## 4.4. System Minutes Lost

This section provides information for system minutes lost (SML) attributable to the transmission system operator.

System minutes lost is a measure of the energy not supplied for a disturbance. The metric takes account of the load lost (MW), duration of disconnection (minutes) and peak system demand (MW), to allow for historical comparison. For example, if 300 MW were lost for 10 minutes and the system peak was 3000 MW, this would represent one system minute.

$$\text{System minutes} = \frac{(\text{load} \times \text{duration})}{(\text{system peak})} = \frac{(300 \times 10)}{(3000)} = 1$$

The total system minutes lost (SML) as a result of faults on the main system for 2022, attributable to EirGrid, was 0.132. There were no under frequency load shedding disturbances which resulted in the disconnection of normal tariff load customers.

The trend of system minutes lost (SML) since 2013 is shown in Figure 7, with incentive / penalty limits and deadbands as provided by the Commission for Regulation of Utilities. The central target provided until 2020 was replaced in 2021 with a deadband between 0.75 and 2.5 SML, where there is neither penalty nor incentive. One fifth of the incentive amount is awarded for every 0.1 SML below 0.75, down to 0.25 SML. One fifth of the incentive amount is penalised for every 0.1 SML above 2.5, up to 3.0 SML.

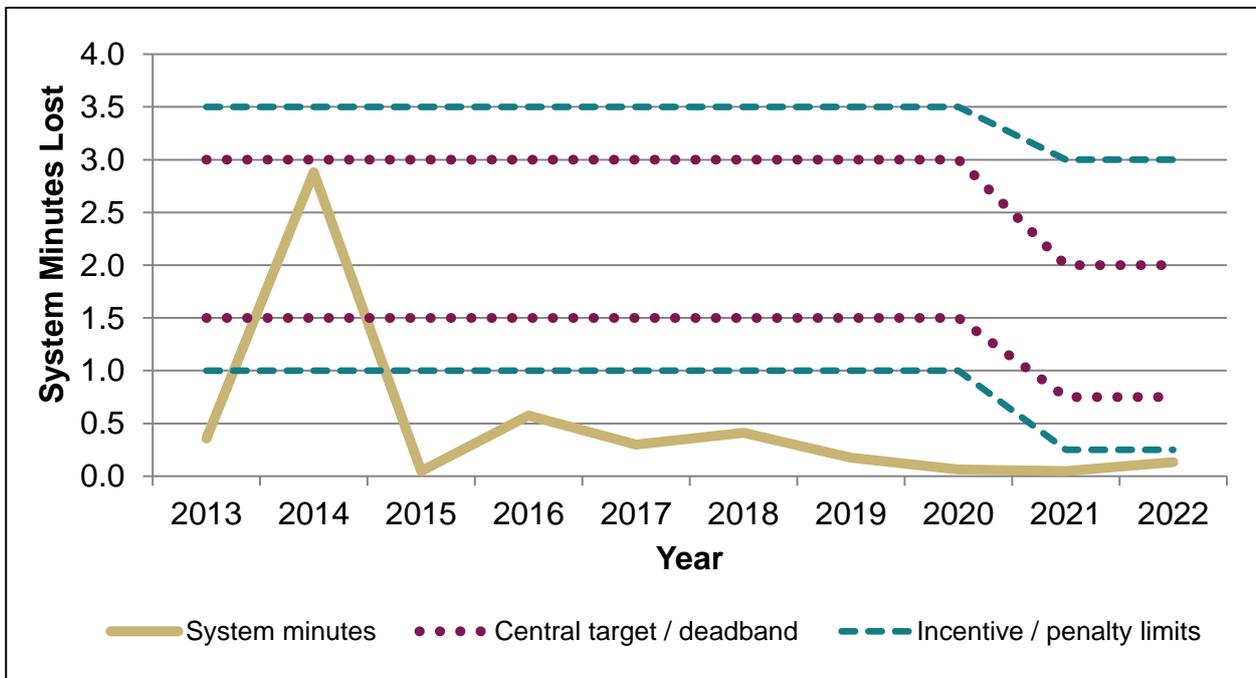


Figure 7: System minutes lost and associated targets: EirGrid 2013-2022

## 4.5. Zone Clearance Ratio

This section provides details of the short circuit faults on the main system and outside the main system for which main system protection is expected to operate without delay.

Zone clearance ratio (ZCR) is defined as the ratio of the number of short circuit faults, not cleared in zone 1 to the total number of short circuit faults per year cleared by main system protection. See Appendix 1 Glossary, for further definition of Zones and ZCR.

Of the 56 short circuit faults in 2022, the main system protection was expected to operate without delay for all 56 of those short circuit faults on the main system. A total of 53 faults had zone 1 clearances, giving a zone clearance ratio of 0.054. The ZCR trend since 2013 is shown in Figure 8.

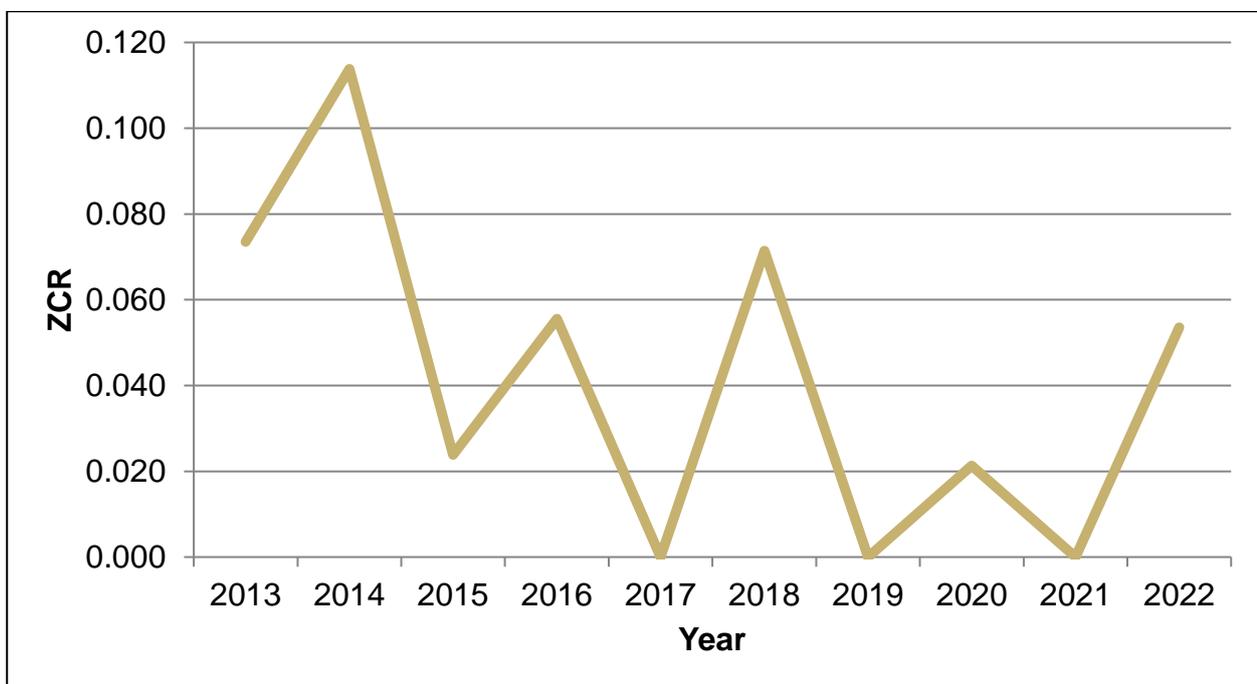


Figure 8: Zone clearance ratio: EirGrid 2013-2022

### 4.5.1. Frequency Control

In 2022 the system frequency was operated between 49.9 Hz to 50.1 Hz for 98.52% of the time.

## 4.6. Summary of key disturbances

### 4.6.1. Loss of load

In February, Knockearagh - Oughteragh - Tralee 110 kV line tripped, reclosed and tripped again for single-phase-to-ground faults (TE). The cause of the fault was wind and a yellow weather warning was in place at the time of the disturbance due to Storm Eunice, with some counties on orange and red weather warnings. The impedance and earth protection operated to clear the fault in 80 ms and 79 ms respectively. An interruption to end-users occurred, resulting in 0.007822 system minutes lost.

In March, the Dallow - Derrycarney - Shannonbridge 110 kV Tee line tripped and reclosed for three-phase-to-ground faults (RSTE). The cause of the faults was lightning, and a local thunder warning was in operation. The impedance and earth protection operated to clear the fault in 95 ms and 112 ms respectively. An interruption to end-users occurred, resulting in 0.030273 system minutes lost.

In August, the T141 110 kV circuit breaker tripped at Tullabrack 110 kV station due to an inadvertent SPS operation. An interruption to end-users occurred, resulting in 0.010388 system minutes lost.

In September, the Coraclassy - Gortawee and Arva - Gortawee 110 kV lines tripped for a two-phase-to-ground fault (STE). The cause of the fault was lightning, and a local thunder warning was in operation. The impedance and earth protection operated to clear the fault in 442 ms. An interruption to end-users occurred, resulting in 0.083696 system minutes lost.

### 4.6.2. Under-Frequency Load Shedding

There were no under frequency load shedding disturbances in 2022.

### 4.6.3. Storms Resulting in Trippings

Between 07:05 on Friday, 18 February 2022 and 04:55 on Monday, 12 February 2022, there were a total of 17 single-phase-to-ground faults and 5 two-phase faults. The cause of the faults was wind caused by Storms Eunice and Franklin. All faults were zone 1 clearances and fault clearance times were between 50 ms and 99 ms. No interruptions to end-users occurred.

## 4.7. Transmission System Availability & Outages

### 4.7.1. Transmission System Availability

When considering transmission system availability, it is the convention to analyse it in terms of transmission system unavailability. The formula for calculating transmission system unavailability is given in Appendix 4 Formulae. Figure 9 shows the percentage Transmission System Unavailability in each month for 2022.

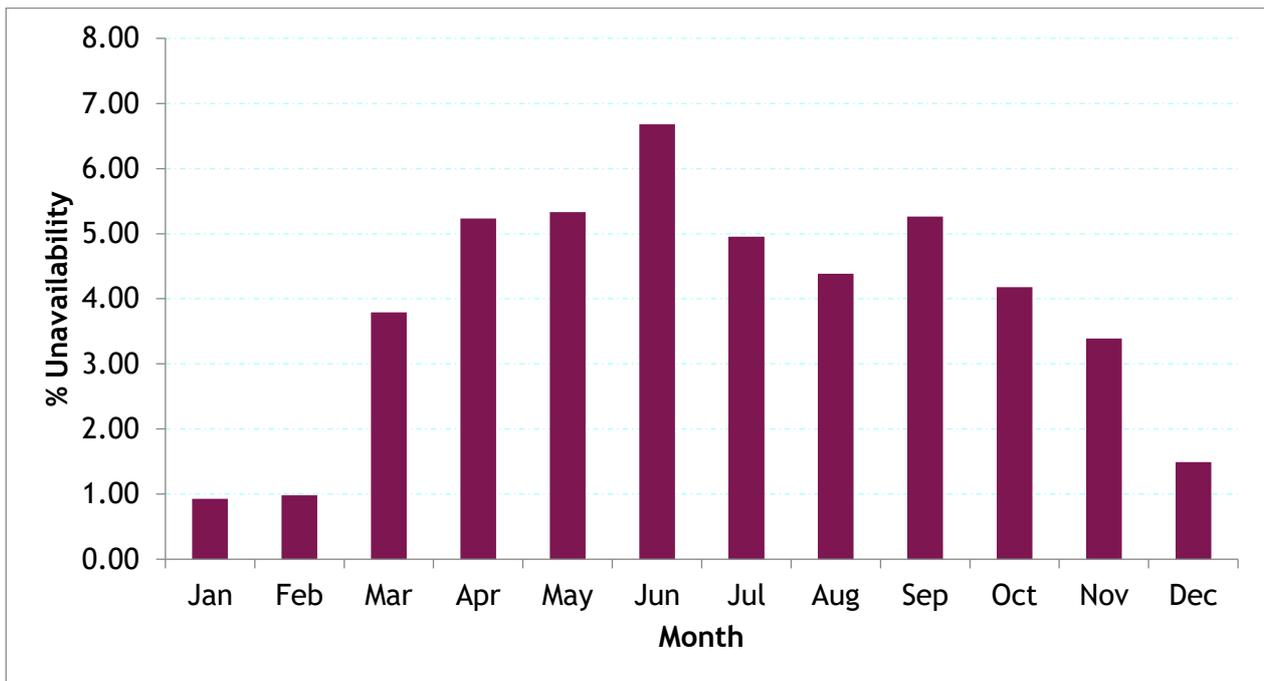


Figure 9: Monthly Variations of Transmission System Unavailability 2022

#### 4.7.2. Transmission Plant Availability

The measure of plant availability is the kilometre-day for feeders and the MVA-day for transformers. The availability figures vary between the different categories of plant. The formulae for calculating transmission plant availability are provided in Appendix 1 Glossary.

Table 6 provides a detailed breakdown of all plant availability figures for 2022.

*Table 6: Transmission System Plant Availability 2022*

Plant Type	Circuit Length [km]	Number of Outages	Availability (%) 2022
110 kV Circuits	4642	311	96.16
220 kV Circuits	1977	69	95.92
275 kV Circuits	97	0	100.00
400 kV Circuits	439	5	99.23
Plant Type	Transformer Capacity [MVA]	Number of Outages	Availability (%) 2022
220 / 110 kV Transformers	11839	59	96.35
275 / 220 kV Transformers	1,200	3	96.80
400 / 220 kV Transformers	3950	13	85.76
Total	7155 km	460	<b>Weighted Average (%)</b>
	16989 MVA		95.99

### 4.7.3. Cause of Transmission Plant Unavailability

Transmission plant unavailability is classified into the categories outlined in Table 7.

Table 7: Transmission System Plant Unavailability Categories

Category	Description
<b>Forced &amp; Fault</b>	Refers to unplanned outages. An item of plant trips or is urgently removed from service. Usually caused by imminent plant failure. There are three types of forced outage: A) Fault & Reclose B) Fault & Forced C) Forced (No Tripping)
<b>Safety &amp; System Security</b>	<b>Safety:</b> Refers to transmission plant outages which are necessary to allow for the safe operation of work to be carried out. <b>System Security:</b> Refers to outages which are necessary to avoid the possibility of cascade tripping or voltage collapse as a result of a single contingency. When a line is out for maintenance it may be necessary to take out additional lines for this reason.
<b>New Works</b>	An outage to install new equipment or uprate existing circuits.
<b>Corrective &amp; Preventative Maintenance</b>	<b>Corrective Maintenance:</b> Is carried out to repair damaged plant. Repairs are not as urgent as in the case of a forced outage. <b>Preventative Maintenance:</b> Is carried out in order to prevent equipment degradation which could lead to plant being forced out over time. Includes line inspections, tests and routine replacements.
<b>Other Reasons</b>	A number of other reasons may be attributed to plant unavailability, such as testing, protection testing and third-party work.

### 4.7.4. 110 kV Circuit Unavailability

Figure 10 provides a breakdown of the causes of unavailability on the 110 kV network in 2022.

The largest contributor to unavailability (66%) on the 110 kV network was attributable to the "Corrective and Preventive" category. This type of maintenance includes, amongst others, ordinary services, condition assessments, wood-pole replacement/straightening and general line maintenance.

A further 26% of unavailability on the 110 kV network in 2022 were outages for the purpose of "New Works". This category is for outages to install new equipment or uprate existing circuits.

5% of unavailability was due to forced outages.

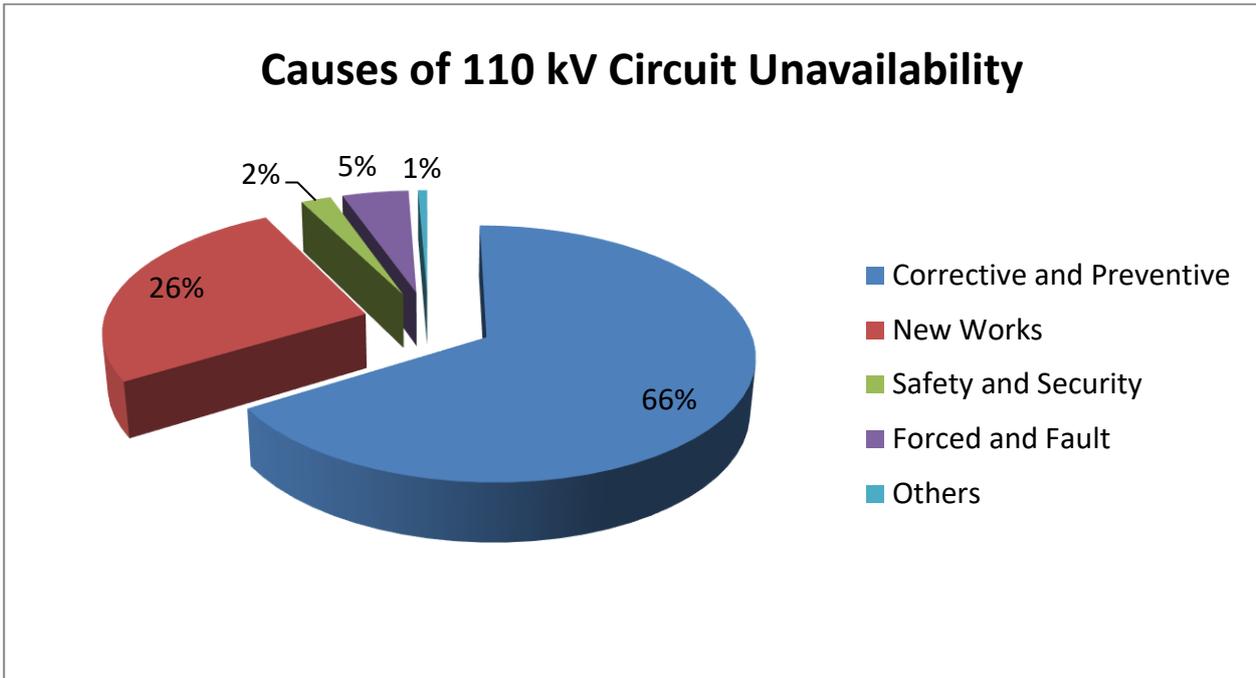


Figure 10: Causes of Unavailability on the 110 kV System in 2022

#### 4.7.5. 220 kV Circuit Unavailability

Figure 11 provides a breakdown of the causes of unavailability on the 220 kV network in 2022. The largest contributor to unavailability (63%) on the 220 kV network in 2022 were outages for the purpose of "Corrective and Preventive". A further 22% of unavailability on the 220 kV network was attributable to "New Works". Approximately 14% of unavailability on the 220 kV network was attributable to Forced and Fault.

## Causes of 220 kV Circuit Unavailability

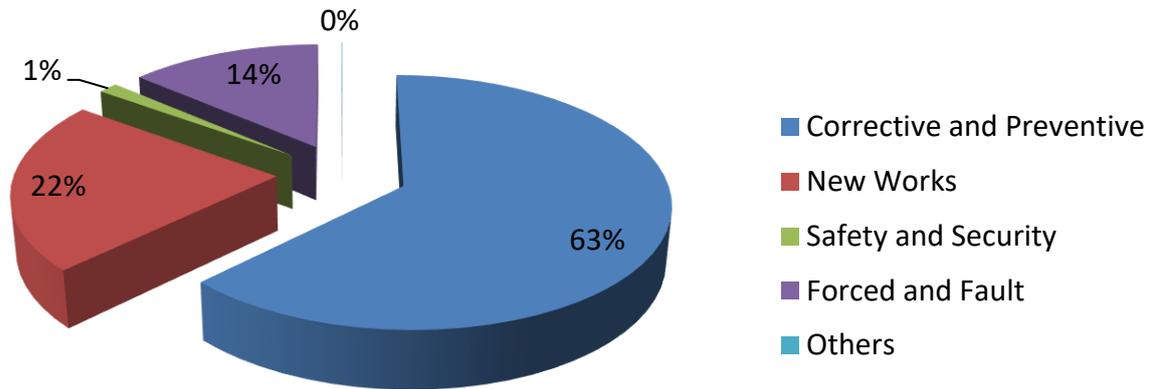


Figure 11: Causes of Unavailability on the 220 kV System in 2022

### 4.7.6. 275 kV Circuit Unavailability

The 275 kV tie-line consists of 48.5 km of 275 kV double-circuit between Louth station and Tandragee station which is situated in County Armagh. In 2022 there were no outages of 275 kV tie-lines.

#### 4.7.7. 400 kV Circuit Unavailability

Figure 12 provides a breakdown of the causes of unavailability on the 400 kV network in 2022. There were 45 days of outages on the 400 kV network in 2022 with the largest contributor being Corrective and Preventive maintenance.

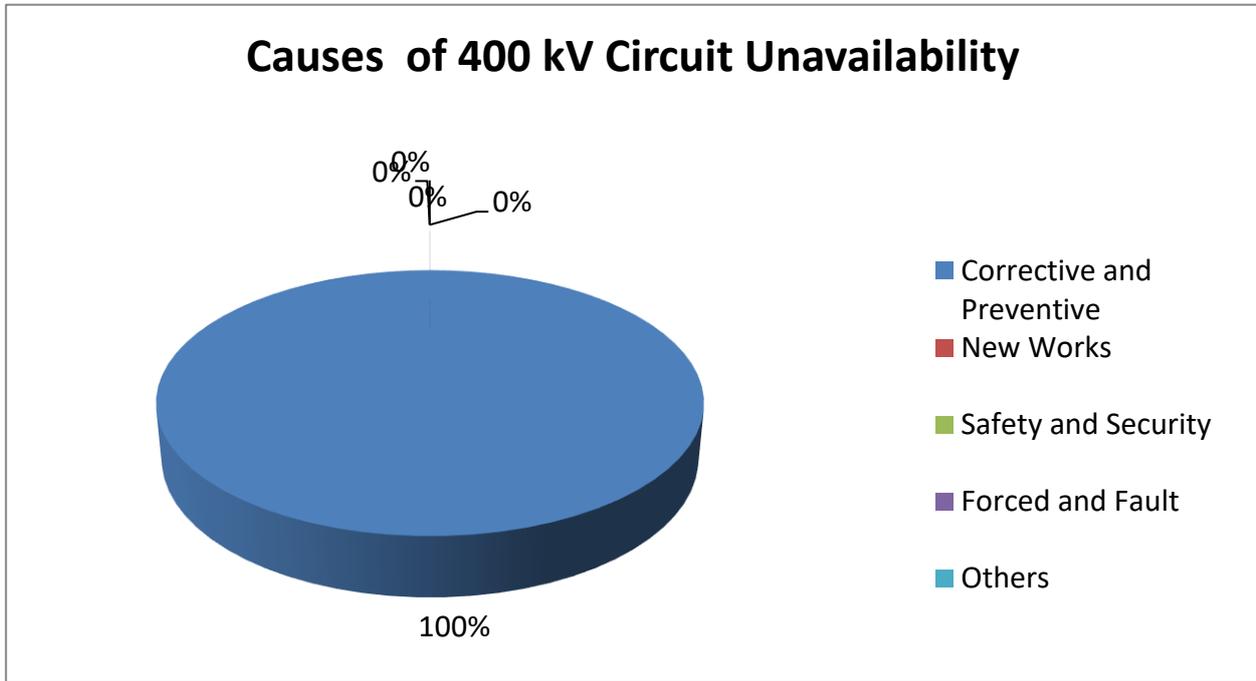


Figure 12: Causes of Unavailability on the 400kV System in 2022

Table 8 provides a breakdown of the transmission system outages that occurred in 2022 by plant type.

*Table 8: Transmission System Plant Outage 2022*

Plant Type	No. of Items	Circuit Length	Forced & Fault	Safety & System Security	New Works	Corrective & Preventive Maintenance	Other	Total No. of Outages
110 kV Circuits	252	4,642	31	9	66	189	16	311
220 kV Circuits	69	1,977	11	3	21	33	1	69
275 kV Circuits	2	97	0	0	0	0	0	0
400 kV Circuits	4	439	0	0	0	3	2	5
<b>Total</b>	<b>327</b>	<b>7,155</b>	<b>42</b>	<b>12</b>	<b>87</b>	<b>225</b>	<b>19</b>	<b>385</b>
Plant Type	No. of Items	Transformer Capacity	Forced & Fault	Safety & System Security	New Works	Corrective & Preventive Maintenance	Other	Total No. of Outages
220 / 110 kV Trafos	58	11,839	7	3	13	35	1	59
275 / 220 kV Trafos	3	1,200	0	0	1	2	0	3
400 / 220 kV Trafos	8	3,950	3	0	2	7	1	13
<b>Total</b>	<b>69</b>	<b>16,989</b>	<b>10</b>	<b>3</b>	<b>16</b>	<b>44</b>	<b>2</b>	<b>75</b>

#### 4.7.8. East West Interconnector

The East West Interconnector (EWIC) is a high-voltage direct current (HVDC) scheme which links the power systems of Ireland and Great Britain. It has a power rating of 500 MW. EWIC is a fully regulated interconnector which was developed and is owned by EirGrid Interconnector DAC (EIDAC) which is part of the EirGrid Group. The scheme consists of two Converter Stations located in Meath, Ireland and Deeside, Wales connected by 264 km HV cable, 185 km of which is submarine.

#### 4.7.9. East West Interconnector Unavailability

In 2022 the availability of the East West Interconnector (EWIC) was 82.7%. Outages contributing to EWIC unavailability mostly included maintenance works.

#### 4.7.10. Transmission Outage Duration

The duration of transmission outages is useful for assessing transmission system performance. Transmission outages are broken into eight time classifications ranging from less than 10 minutes to greater than four weeks. The total number of outages in each time classification is shown in Figure 13.

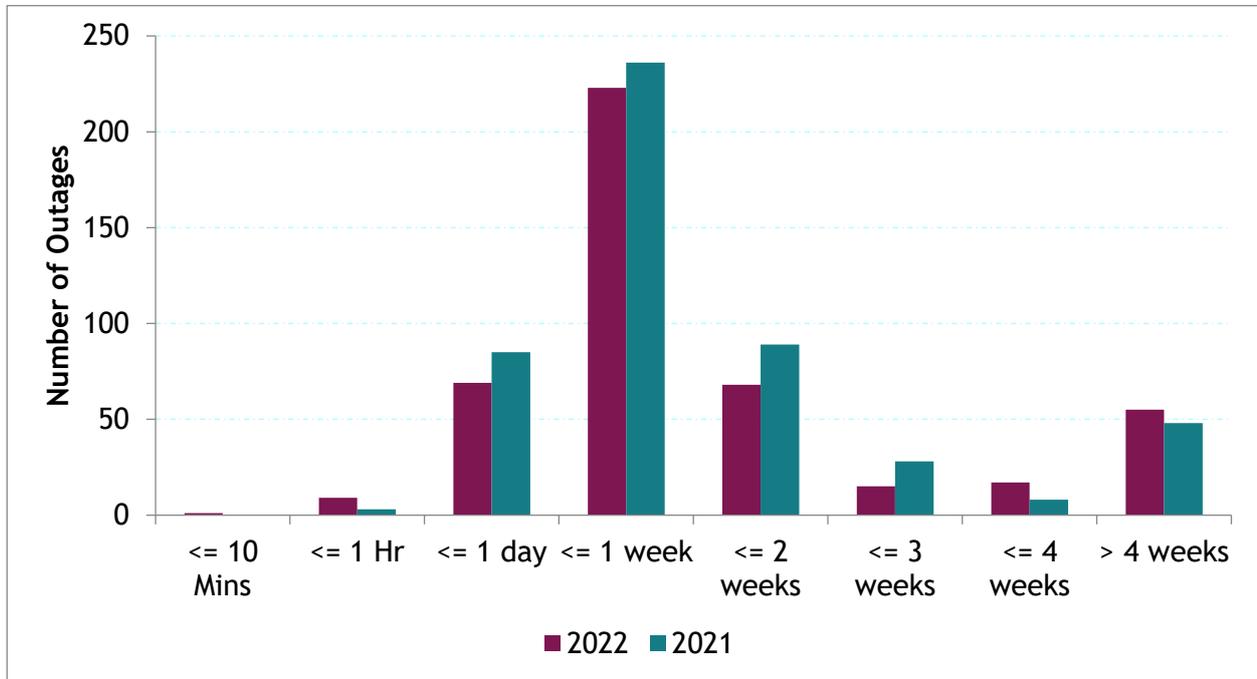


Figure 13: Duration of Outages in 2021 & 2022

The majority of the outage durations are concentrated between one day and 2 weeks with the peak occurring between one day and 1 week. In the category of one hour to one day, outages can be arranged to avoid peak load times and thereby reduce the impact on the system, while one-week outages for annual maintenance are commonplace during the outage season.

#### 4.7.11. Timing of Transmission Outages

Transmission outages are scheduled, where possible, during periods of low load in the summertime (however, this can be limited by a number of factors such as personnel availability and shortage of hydro-power support in some areas). The seasonal nature of transmission outages is apparent in Figure 14 below.

Figure 14 shows the percentage unavailability of the transmission system in each month. The March-November period (known as the outage season) sees the highest rates of unavailability during the year, when decreased system load is taken advantage of to carry out extensive maintenance outages. Figure 15 shows the average duration in days of the transmission outages in each month in 2022.

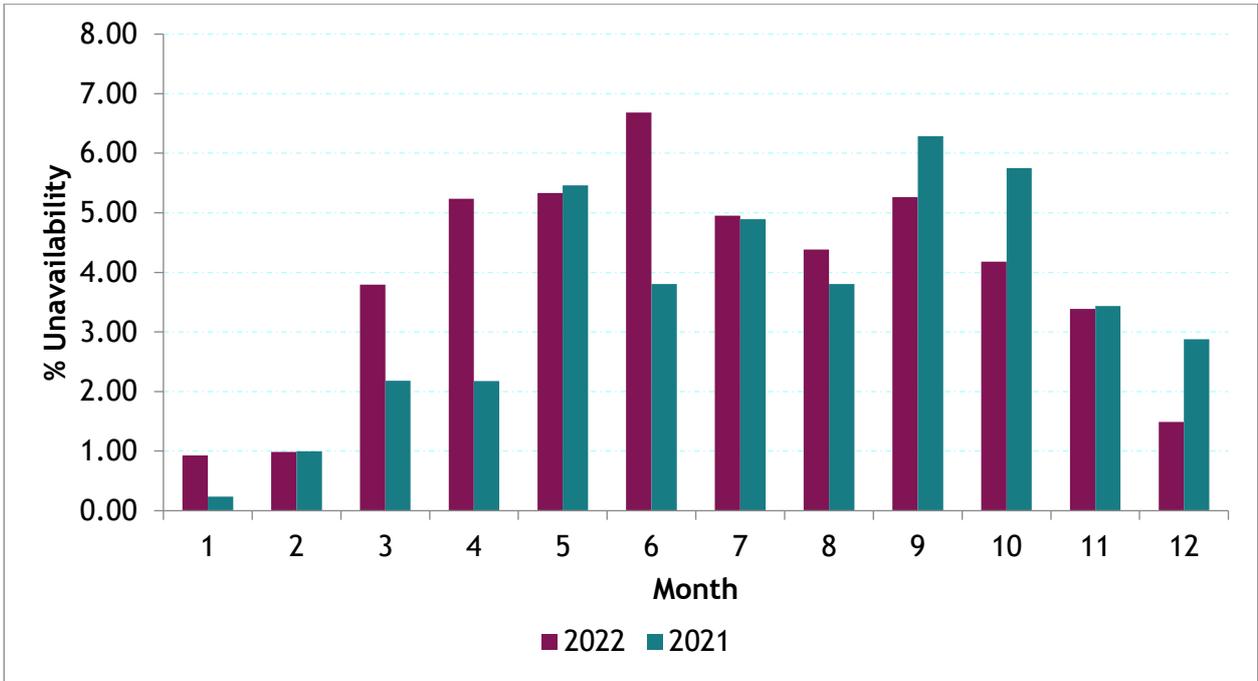


Figure 14: Percentage unavailability in each month of 2021 & 2022

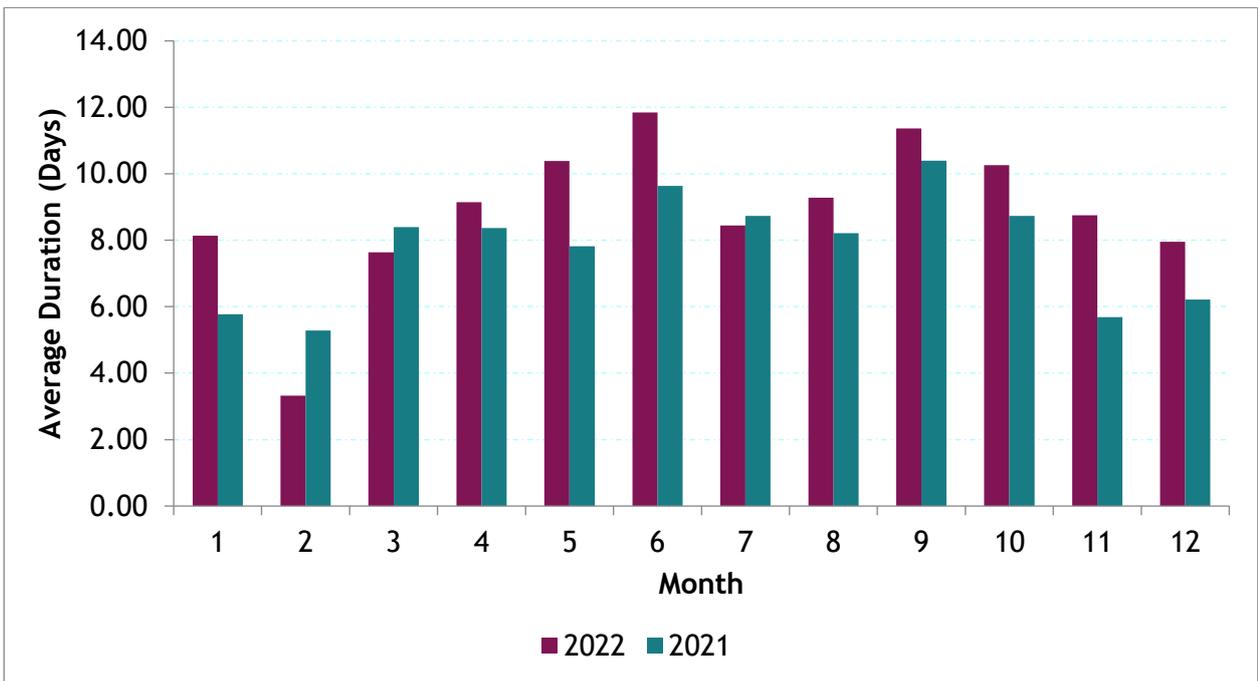


Figure 15: Average duration of outages 2021 & 2022

#### 4.7.12. Forced Outages

There are two main outage classifications, voluntary outages and forced outages. The majority of outages are voluntary outages that are scheduled by EirGrid. Forced outages are not scheduled and cause the most disruption to the transmission system. Due to their disruptive nature, forced outages merit further analysis.

#### 4.7.13. Forced Outages per km

The measure used for analysing the forced outages of lines and cables is the number of forced outages per kilometre of feeder and is shown in Figure 16.

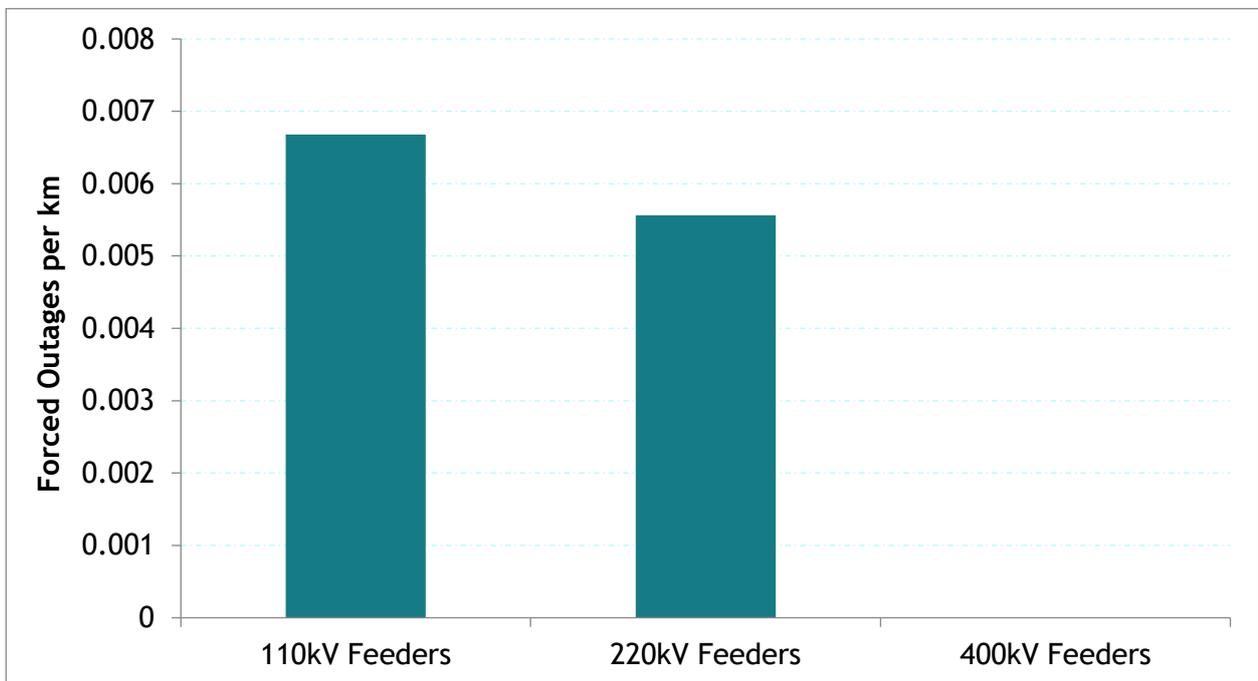


Figure 16: Forced Outages of lines and cables per km in 2022.

#### 4.7.14. Forced Outages per MVA

The measure used for analysing the forced outages of transformers is the number of forced outages per MVA capacity, which can be seen in Figure 17.

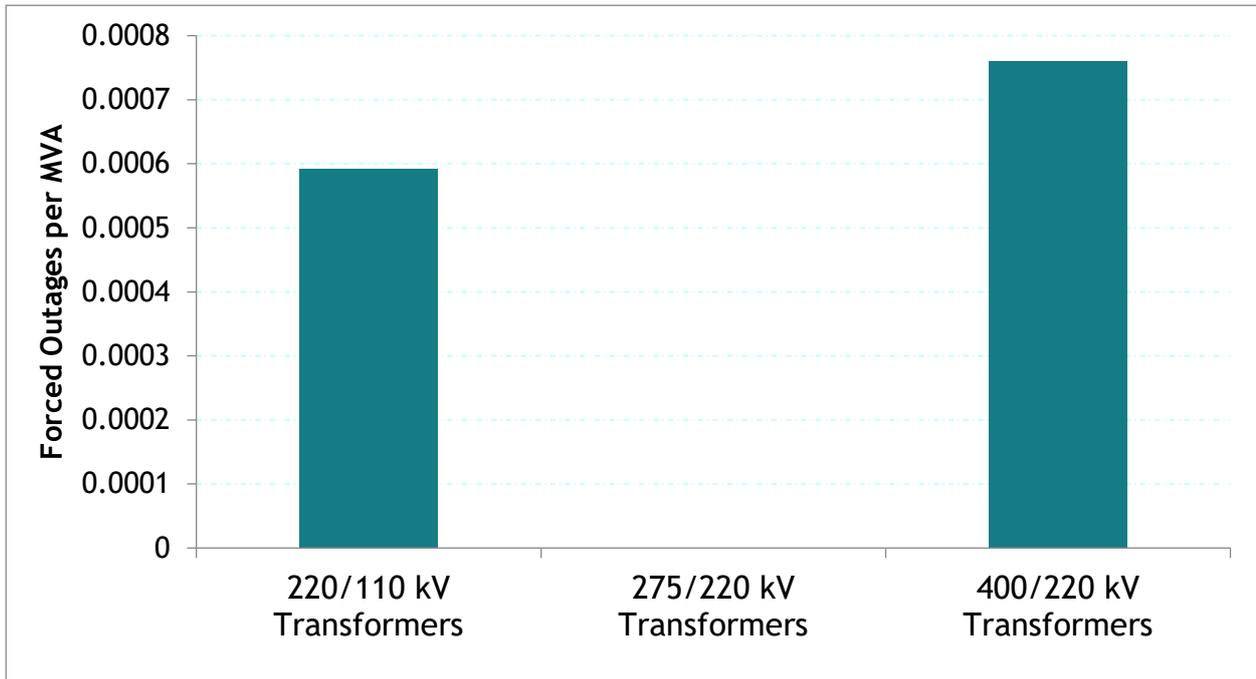


Figure 17: Forced Outage per MVA in 2022

# 5. SONI Transmission System Performance

This section details the performance of the transmission system in Northern Ireland, unless explicitly stated otherwise. This data has been prepared by SONI in accordance with Condition 20 of the 'Licence to participate in the Transmission of Electricity.

## 5.1. Summary

SONI is responsible for the safe, secure, efficient and reliable operation of the Northern Ireland transmission network. The transmission network is operated at 275 kV and 110 kV and is made up of 116 circuits covering a total length of approximately 2,311 km. The primary purpose of the transmission system is to transport power from generators and interconnectors to bulk supply points which connect the transmission system to the distribution system.

Availability is a key measure of power system performance. In this report availability refers to the proportion of time a transmission circuit or interconnector was available.

- The annual system availability for 2022 was 97.6%.
- The annual availability of the Moyle Interconnector for 2022 was 79.48 %.
- The North-South 275 kV tie line, connecting Louth in Ireland and Tandragee in Northern Ireland had an availability of 100% in 2022.
- The annual availability of the Strabane - Letterkenny and Enniskillen - Corraclassy 110 kV tie lines were 99.91% and 100%, respectively, in 2022.

The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 set out the statutory obligations in relation to managing both frequency and voltage for Northern Ireland. Under the regulations SONI is required to report incidents, which have caused interruptions to supply to customers, to the transmission asset owner, NIE Networks. Part 8, paragraph 33 of the regulation contains details of the requirements for the reporting of incidents.

In 2022, there was one transmission incident leading to customers being off supply. This was at 11:11 on 11 March when an incident at Carnmoney resulted in the loss of supply to 20,908 customers, equating to a total loss of 24 MW. The total system minutes lost for this event was 0.021 minutes.

Quality of service is measured by the number of voltage excursions which fall outside statutory limits. There were no voltage excursions in 2022 outside the statutory limits.

## 5.2. Transmission System Availability

### 5.2.1. System Availability

Transmission system availability is the proportion of time a transmission circuit was available during the calendar year. A circuit is defined as the overhead line, cable, transformer or any combination of these that connects two busbars together or connects the transmission system to another system. Transmission system availability is reduced when a circuit is taken out of service, either for planned or unplanned purposes.

Planned outages are necessary to facilitate new user connections, network development and maintenance of network assets necessary to deliver acceptable levels of system security and reliability. These are outages planned with at least seven days' notice.

Unplanned outages can be a result of equipment failure or a fault caused by adverse weather etc. These are outages required immediately or planned with less than seven days' notice.

System Availability is calculated using the formula:

$$\text{System Availability (\%)} = \frac{\sum \text{Hours each circuit is available}}{(\text{No. of Circuits}) * (\text{Total No. Hours in Period})}$$

In 2022, the analysis of the transmission system availability data has produced the following results:

- The average availability of the Northern Ireland transmission system was in 2022 was 97.60%
- The average winter system availability (for the winter months January, February, November and December 2022) was 98.36%.

Figure 18 below shows the month-by-month variation in Transmission System Availability in Northern Ireland.

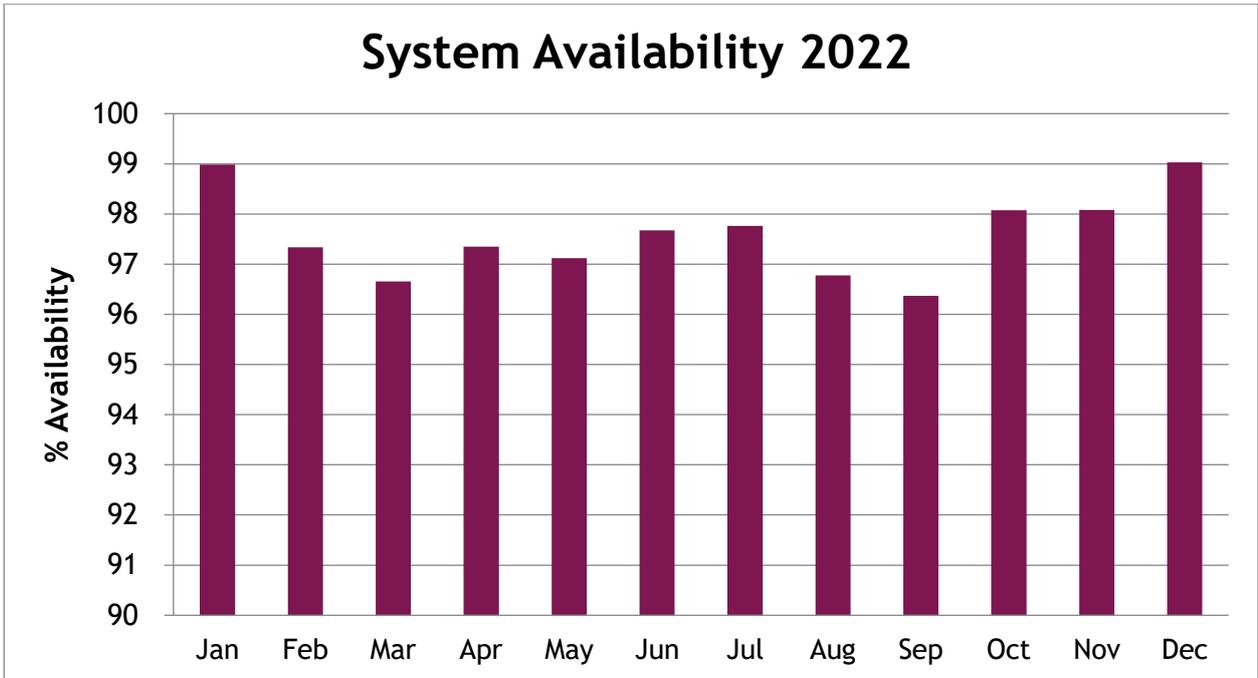


Figure 18: Transmission System Availability 2022

Overall, the availability of the system is high, particularly over the winter months, such as January and December, where maintenance is avoided due to the higher electrical demand and potential adverse weather conditions. The preference is for maintenance to take place over the summer months when network loading is generally lower to mitigate the risk of affecting the supply to customers.

### 5.2.2. System Unavailability

Figure 19 below shows the month-by-month variation in planned and unplanned system unavailability.

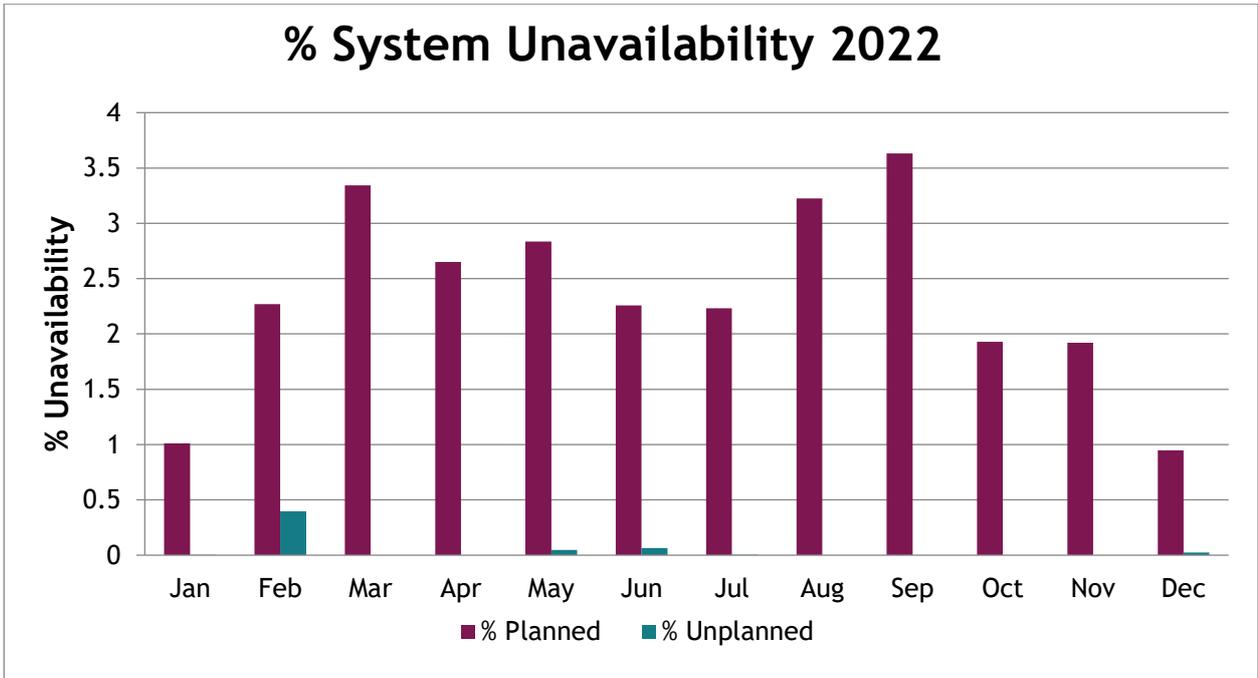


Figure 19: Transmission System Unavailability 2022

Transmission outages are planned during the spring/ summer/ autumn months where possible. This is to take advantage of periods when the Northern Ireland demand is lower and hence power flows around the transmission system are reduced. During the winter months when demand is higher, only urgent outages or outages that will not reduce the reliability of the transmission system can be accommodated. This is to ensure the resilience of the transmission system is maintained.

### 5.2.3. System Historical Availability Performance

Figure 20 shows the historic variation in system availability from 2013 to 2022 for the transmission network in Northern Ireland.

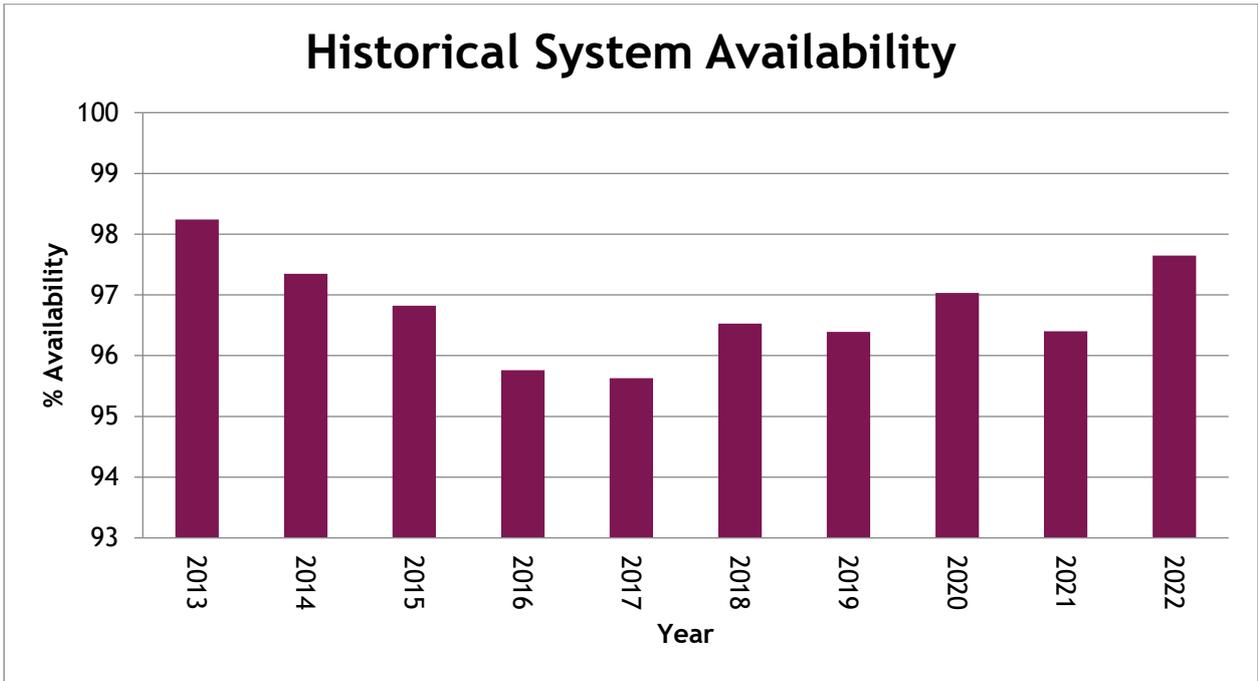


Figure 20: Historical System Availability 2013 to 2022

#### 5.2.4. System Historical Unavailability Performance

Figure 21 below shows the breakdown of the system unavailability from 2013 to 2022.

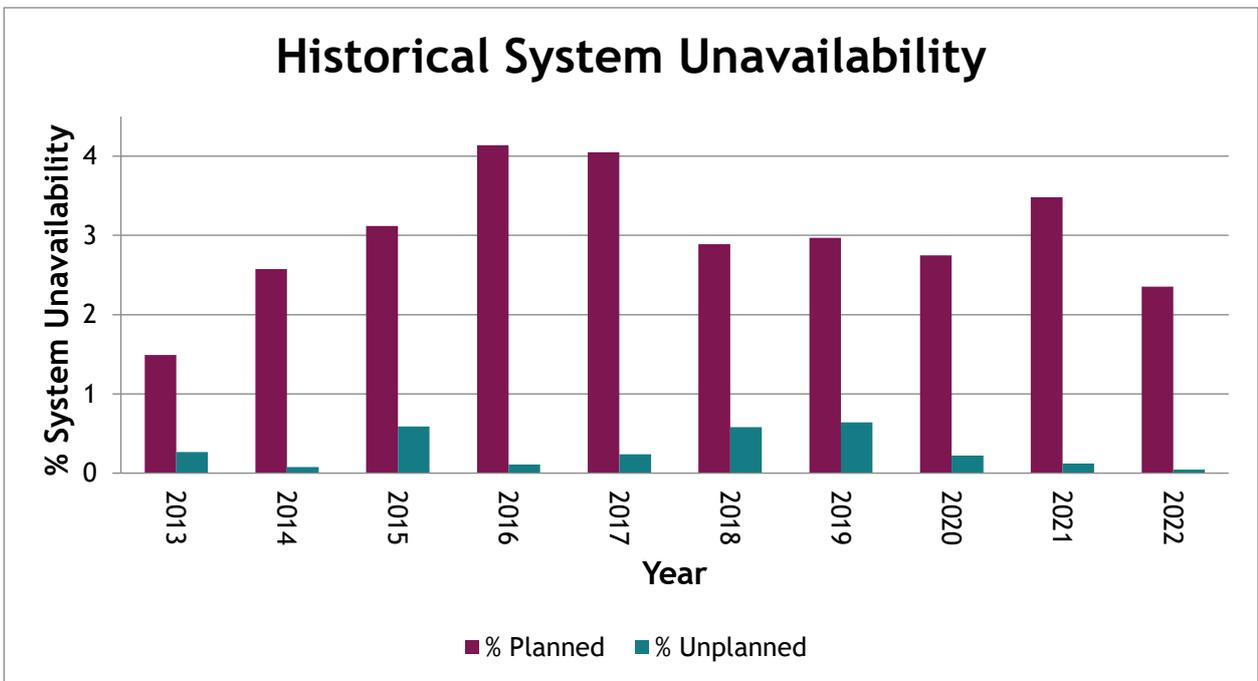


Figure 21: Historical System Unavailability 2013 to 2022

### 5.2.5. Moyle Interconnector

The Moyle interconnector, owned by Mutual Energy, connects the power systems of Northern Ireland and Scotland. The interconnector is a High Voltage Direct Current (HVDC) system; consisting of two submarine power cables and two HVDC-AC converter stations; one located at Islandmagee in Northern Ireland and the other at Auchencrosh in Scotland.

The interconnector has an operational import capacity of 441 MW and an operational export capacity of a maximum 410 MW (values with reference to the NI system). Until 31 March 2022 the firm export limit on Moyle was 275 MW (GB reference value) due to network limitations in Scotland. An agreed process between Moyle and NGEN was in place to release additional “non-firm” export capacity when GB system conditions allowed. As of 1 April 2022, the firm export limit increased to 400 MW (GB reference value, 410 MW with respect to NI), in line with the operational export capacity.

The interconnector is operated by SONI, and the performance of the interconnector is detailed in this report.

During 2022, Moyle availability was significantly eroded by a project to upgrade the interconnector control system which spanned a 19-week period.

### 5.2.6. Moyle Interconnector Historical Availability

The Annual Availability of the Moyle Interconnector for 2022 was 79.48%.

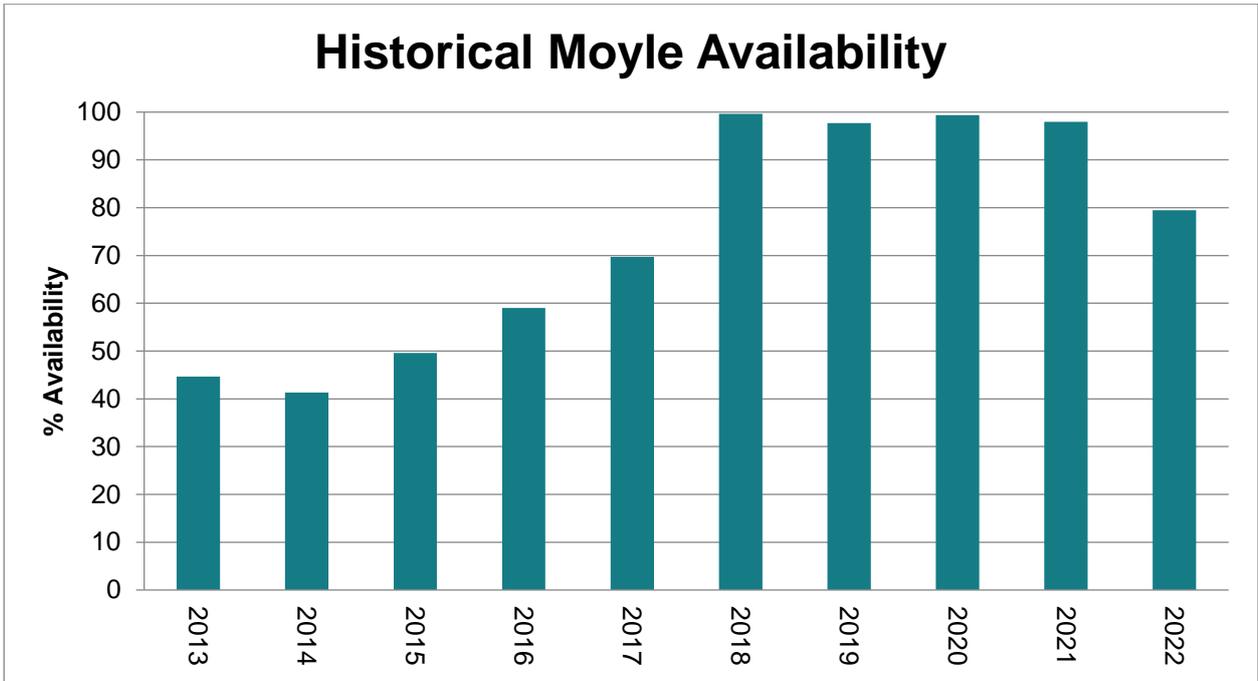


Figure 22: Historical Moyle Interconnector Availability 2013 to 2022

#### 5.2.7. Moyle Interconnector Historical Unavailability

The 2022 Annual Unavailability of the Moyle Interconnector was 20.52%.

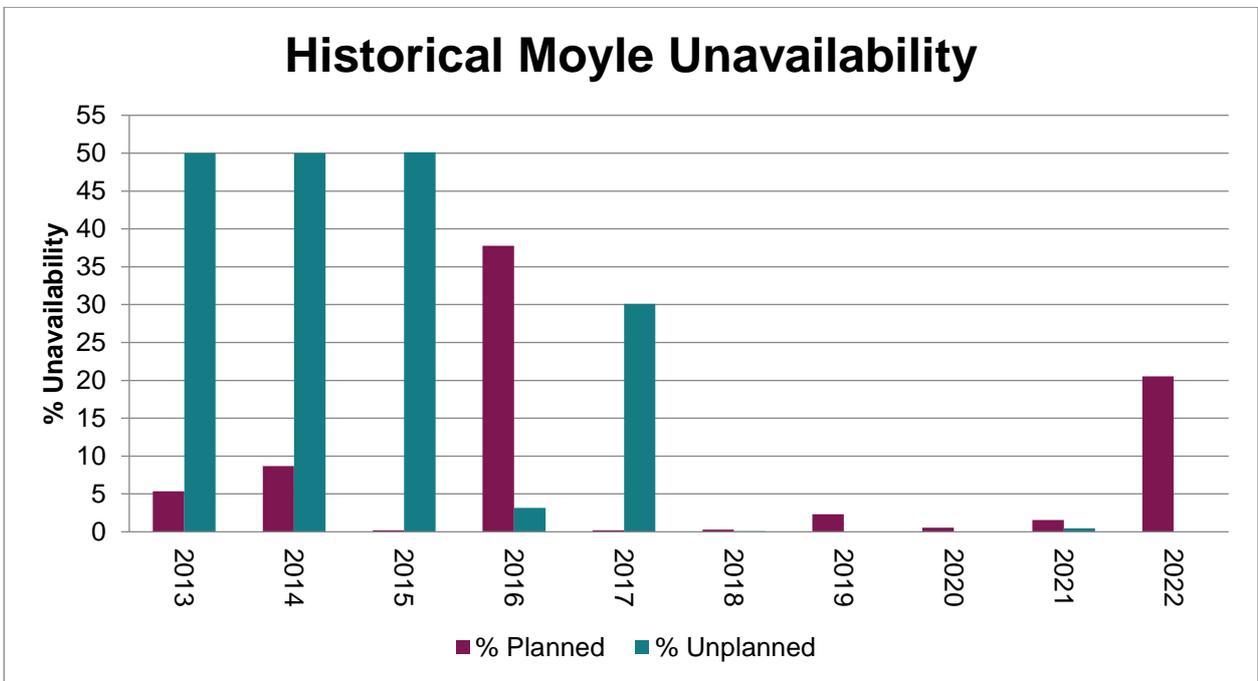


Figure 23: Historical Moyle Interconnector Unavailability 2013 to 2022

### 5.2.8. Moyle Interconnector Monthly Unavailability

Figure 24 below shows the month-by-month variation of unavailability of the interconnector.

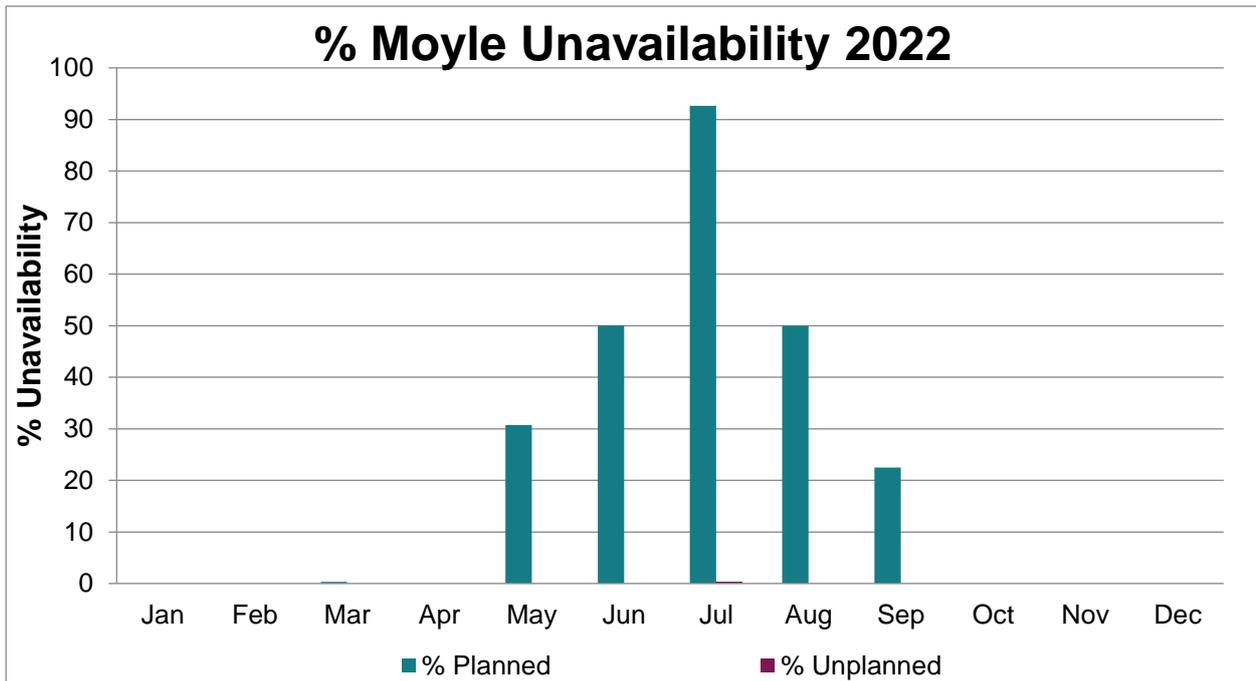


Figure 24: Moyle Interconnector Monthly Unavailability 2022

Figure 24 shows there were scheduled outages of the interconnector throughout months March to September. The outages were a mixture of single-pole (one cable remaining in service) and bi-pole (total station) outages, as required by the work and commissioning plan. The most significant scheduled outage was an 8-day bi-pole outage which occurred in July. There were 2 forced outages of the interconnector throughout the year, both occurred in July 2022.

### 5.2.9. 275 kV Tie Line

The connections between Ireland and Northern Ireland are referred to as ‘Tie Lines’.

The Northern Ireland transmission system is connected to the transmission system in Ireland by means of one 275 kV double-circuit connection from Tandragee 275 kV substation in Co. Armagh to Louth 275 kV substation in Co. Louth.

The 275 kV double-circuit tie line is used as the method for synchronising the Northern Ireland and Ireland power systems together. Energy can flow freely between both jurisdictions, depending on the operating requirements and generating plant being utilised on the all-island power system.

The annual average availability of the 275 kV North-South Tie Line in 2022 was 100%.

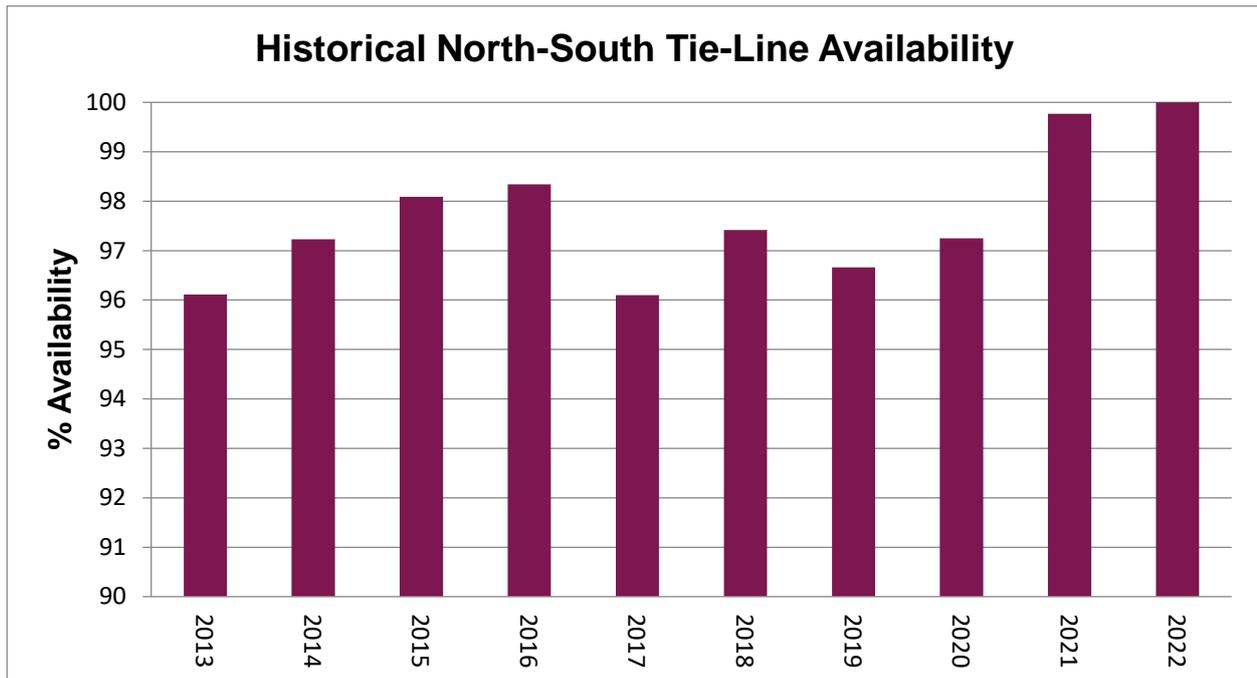


Figure 25: Historical North-South Tie Line Availability 2022

#### 5.2.10. 110 kV Tie lines

There are two 110 kV connections between Ireland and Northern Ireland:

- Strabane - Letterkenny 110 kV circuit
- Enniskillen - Corraclassy 110 kV circuit

These 110 kV tie lines provide an AC connection between the two transmission systems, which allows emergency flows of active and reactive power for frequency and voltage support, increasing system stability.

Phase Shifting Transformers (PSTs), designed for energy to flow in two directions, are installed at Strabane and Enniskillen and control the flow of energy between Ireland and Northern Ireland. These PSTs are rated at 125 MW each and are, in normal operation, operated to maintain a 0 MW flow between both jurisdictions.

To negate any potential system abnormalities as a result of transmission outages, either scheduled or unplanned, a controlled flow can be allowed, to support system operation in both jurisdictions. Also, in times of high wind, the Strabane-Letterkenny tie line is used to import excess wind energy being produced in the north-west of Ireland.

The availability of the 110 kV Tie Lines was 99.95% in 2022.

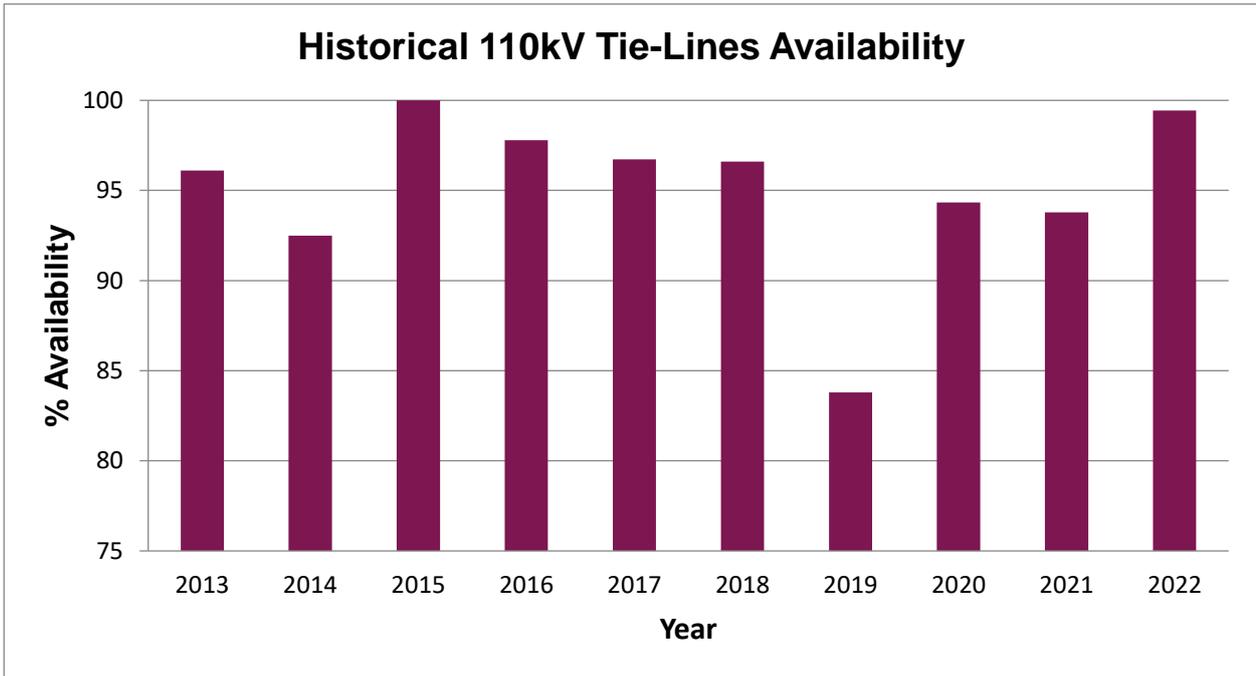


Figure 26: North-South Tie Line Availability 2013 to 2022

A breakdown of 110 kV tie line unavailability is shown in Figure 27 below.

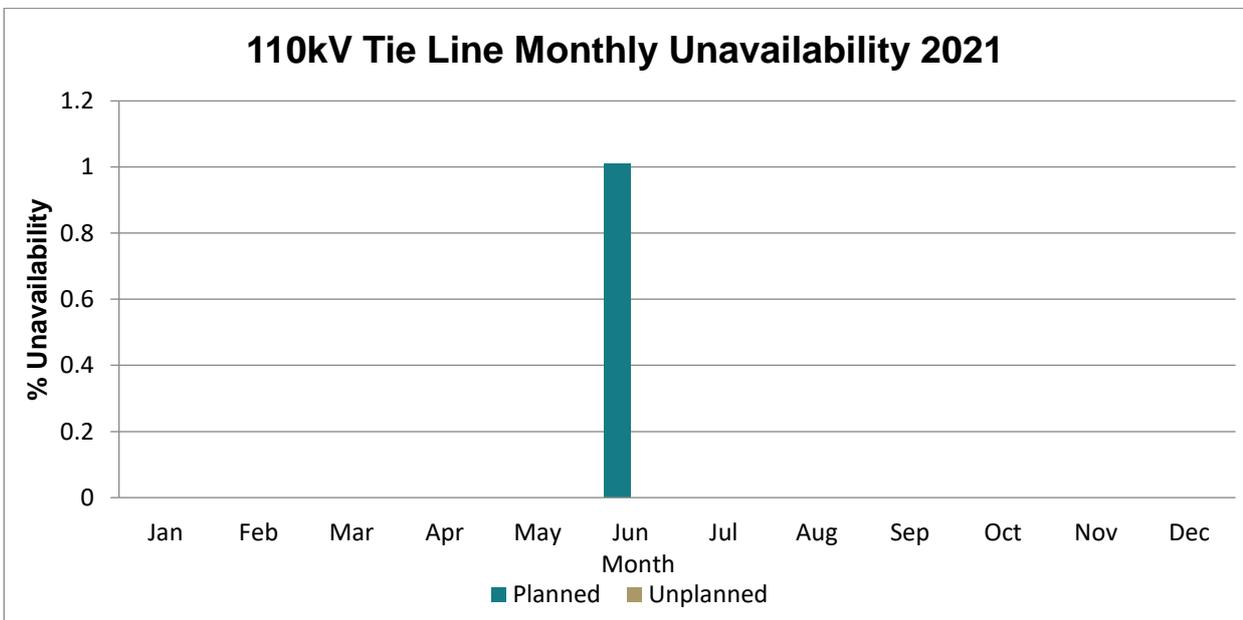


Figure 27: 110kV Tie Line Unavailability 2022

## 5.3. Transmission System Security

An incident is a system event that results in loss of supply. In this section incidents resulting from issues on the Northern Ireland Transmission system are described individually. The following sections detail the nature, location and duration of the incidents with an estimate of energy unsupplied.

### 5.3.1. Incidents for 2022

The criterion for the reporting of incidents is specified in Part 8, paragraph 33, of 'The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012'. An incident shall be reported if there has been:

- any single interruption of supply, to any demand of 20 MW or more at the time of the interruption, for a period of three minutes or longer; or
- any single interruption of supply, to any demand of 5 MW or more at the time of the interruption, for a period of one hour or longer; or
- any single interruption of supply to 5,000 or more consumer's installations for a period of one hour or longer.

### 5.3.2. Number of Incidents and Estimated Unsupplied Energy

In 2022, there was one system event in Northern Ireland that resulted in the loss of supply to customers. Details of this event are given below.

- At 11:11 on 11 March, an incident occurred at Carnmoney substation. This event resulted in the loss of supply to 20,908 customers, equating to a total loss of 24 MW. All customers were fully restored within 1 minute and 35 seconds of the event happening.

### 5.3.3. Incident Analysis

Figure 28 details the incidents that have occurred historically in Northern Ireland.

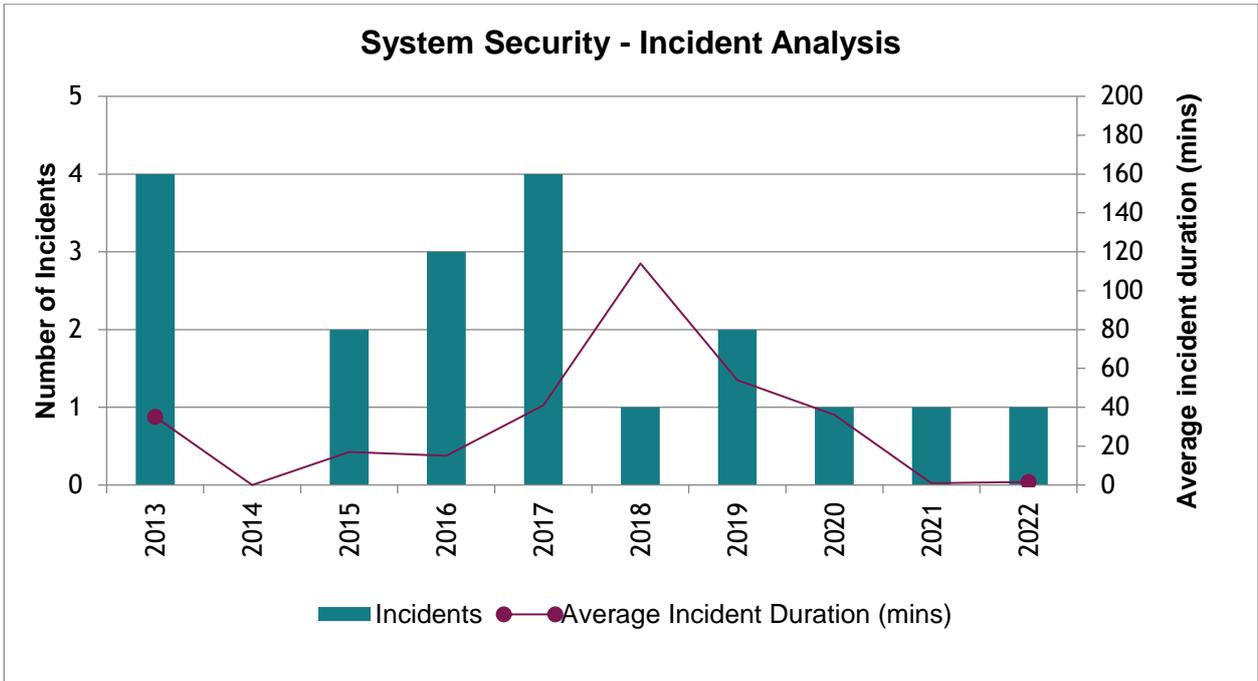


Figure 28: Historical System Security 2013 to 2022

#### 5.3.4. Unsupplied Energy

Figure 29 below shows the historical amount of unsupplied energy to Northern Ireland customers.

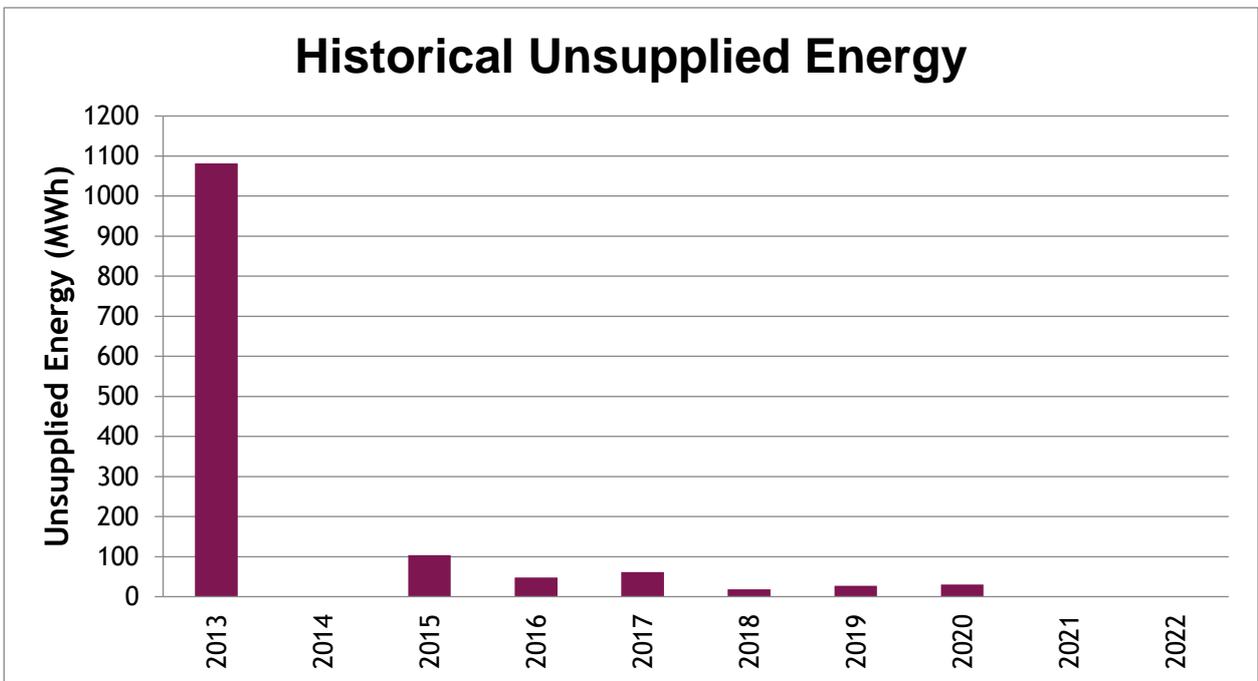


Figure 29: Historical Unsupplied Energy 2013 to 2022

### 5.3.5. System minutes lost

The total system minutes lost for 2022, attributable to SONI, was 0.021. The trend of system minutes lost since 2013 is shown in Figure 30.

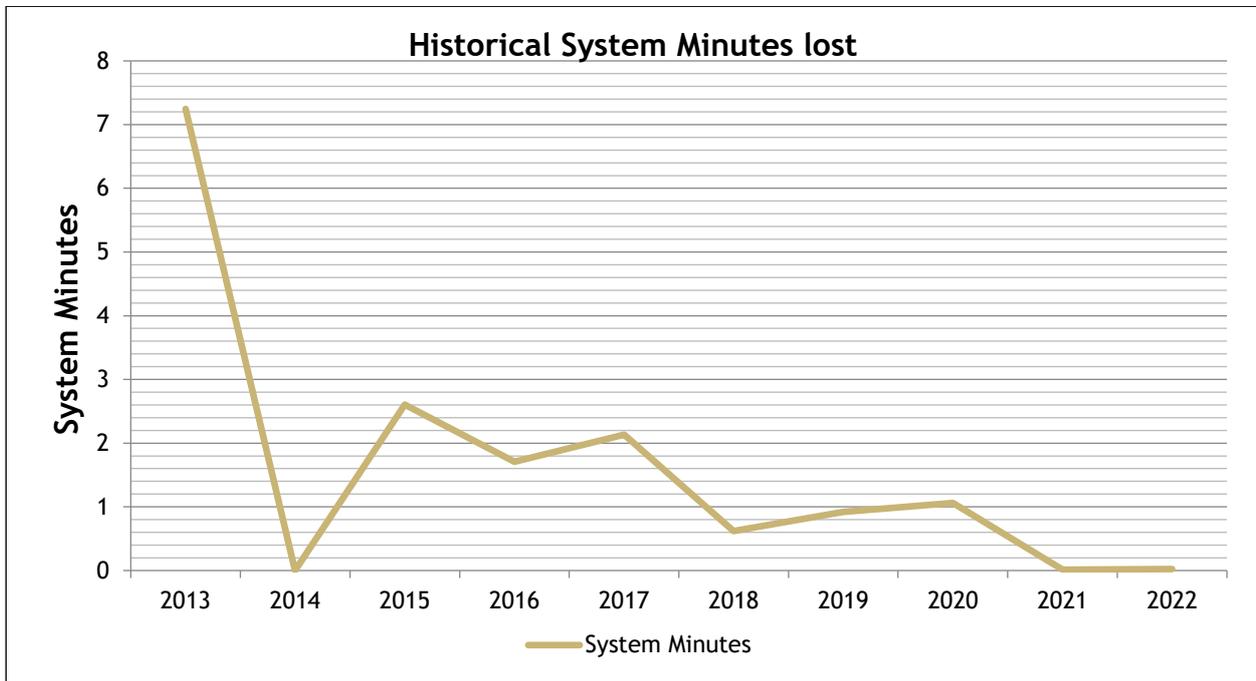


Figure 30: System minutes lost 2013 - 2022

### 5.3.6. Zone Clearance Ratio

The Zone Clearance Ratio (ZCR) is defined as the ratio of the number of short circuit system faults not cleared in Zone 1 to the total number of short circuit faults per year cleared by Main System protection. See “Zones of Protection” for further definition of Zones and ZCR. In 2022, the ZCR was 0. There were (3) system faults cleared by protection on the main system. Each fault was cleared in zone 1.

## 5.4. Quality of Service

Quality of service is measured with reference to system voltage and frequency.

### 5.4.1. Voltage

The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 details the requirements for the management of voltage in Northern Ireland.

Part 7, paragraph 28 permit variations not exceeding 10% for operating voltages of 110 kV or higher. As well as adhering to legislation, SONI also operates the transmission system in such a way as to comply with the Operating Security Standards<sup>7</sup>, acceptable step changes in voltages are detailed in Table 9.

*Table 9: Voltage step change limits in operational timescales*

Transmission System secured events or switching event	Voltage fall	Voltage rise
Following loss of single circuit	-6%	+6%
Following loss of double circuit overhead line	-10%	+6%

### 5.4.2. Voltage Excursions

There were no voltage excursions exceeding these limits in 2022.

### 5.4.3. Frequency

SONI is required to manage the frequency of the power system. Power system frequency is a measure of balance between the electrical demand on the network and the amount of energy being generated. The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 details the requirements for the management of Frequency in Northern Ireland.

Part 7, paragraph 28 of the regulations permits a frequency variation of up to 0.5 Hz above or below 50 Hz. In 2022 there were no reportable frequency excursions in Northern Ireland in 2022.

---

<sup>7</sup> [SONI Operating Security Standards](#)

The most severe frequency excursion in Northern Ireland in 2022 occurred on 2 November. One large generator tripped causing the frequency to drop to 49.65 Hz, however, fast frequency response available on the system helped to arrest the system frequency drop and stabilise the system frequency.

#### 5.4.4. Frequency Excursions

There were no reportable frequency excursions in Northern Ireland in 2022.

#### 5.4.5. Historical Frequency Excursions

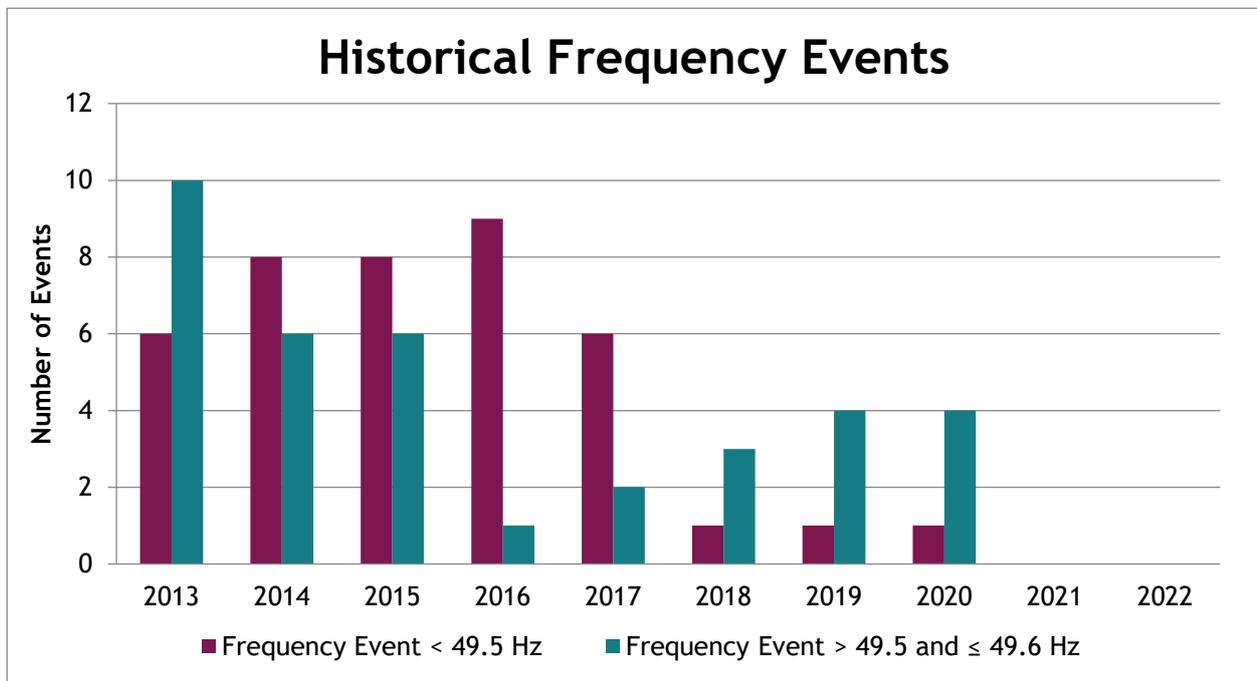


Figure 31: Historic Frequency Excursions 2013-2022

# 6. Appendix 1 Glossary

## 6.1. DCEF

Directional comparison earth fault. A teleprotection scheme that allows accelerated tripping by exchanging permit and receive signals for earth faults in a relay's forward direction.

## 6.2. Disturbance

A system disturbance is defined as one or more related faults and their consequences which occur either simultaneously or over a period of time. These incidents are grouped in a single system disturbance report under the highest voltage involved.

## 6.3. Fault

Any abnormal event causing or requiring the tripping of a Main System circuit breaker automatically within the Main System. Any abnormal event causing or requiring the closing of a Main System circuit breaker automatically within the Main System. Any abnormal event causing or requiring the tripping of an MV circuit breaker automatically by under frequency relay operation.

## 6.4. Main system: EirGrid

The main transmission system includes: the 400 kV, 220 kV and 110 kV overhead line (OHL) and underground cable (UGC) network, the 400 kV, 220 kV and 110 kV busbars and couplers, the 400/220 kV and 220/110 kV coupling transformers (with the exception of those feeding the Dublin city 110 kV network). It also includes the 275 kV ESB/NIE Networks interconnector as far as the border with Northern Ireland, and the associated 275/220 kV transformers. The main transmission system does not include the Dublin city 110 kV network or the 220/110 kV coupling transformers at Carrickmines, Inchicore and Poolbeg. The HV circuit breakers of tail connected lines and directly connected transformers (DSO load, directly connected industrial customer load, generator and HVDC interconnector transformers) are part of the main transmission system thus faults on these lines and transformers, which cause transmission system circuit breakers to be tripped, are reported.

## 6.5. Main system: SONI

The main transmission system includes: the 275 kV and 110 kV OHL and UGC network, the 275 kV and 110 kV busbars and couplers, the 275/110 kV interbus transformers, and all 110/33 kV transformers (aka main transformers). It also includes the 275 kV ESB/NIE Networks interconnector as far as the border with Ireland. The HV circuit breakers of directly connected transformers (generator and HVDC interconnector transformers) are part of the main transmission system thus faults on these transformers, which cause transmission system circuit breakers to be tripped, are reported.

## 6.6. Major incident

A major incident is one which results in the loss of greater than or equal to one system minute as a result of a single system disturbance.

## 6.7. MVA Minute Lost

Amount of Power (Mega Volt-Amp) not supplied during an interruption of one minute.

## 6.8. Non main system/outside the main system: EirGrid

All HV plant on the Irish electricity network that does not form part of the main system: the Dublin 110 kV network (controlled by the DSO at the northern distribution control centre (NDCC). The MV system in Ireland is controlled by the NDCC in Leopardstown), all DSO and industrial customer load transformers, all IPP generator transformers, and all plant on the NIE Networks owned, SONI controlled, HV system in Northern Ireland.

## 6.9. Non main system/outside the main system: SONI

All HV plant connected to the Northern Irish electricity network that does not form part of the main system: all IPP generator transformers, HVDC interconnector transformers, and all plant on the ESB owned, EirGrid controlled, HV system in Ireland.

## 6.10. Non-System Fault

Any unplanned circuit breaker operation resulting from a cause other than a system fault or incorrect manual operation from a control point.

## 6.11. Permanent Fault

A fault is permanent if the component or unit is damaged and cannot be restored to service until repair or replacement is completed. An overhead line trips and stays out of service due to the absence or outage of reclosing facilities; the fault is permanent if maintenance staff must carry out equipment repairs or replacement before the line is returned to service. A protection setting change is required on the piece of plant before or after it is switched in following a fault.

## 6.12. POTT

Permissive overreach transfer trip. A distance teleprotection scheme that allows accelerated tripping by exchanging permit and receive signals for faults in a relay's zone 2.

## 6.13. Protection - Correct Operation

The operation is correct if a fault is cleared by the protection (in any time step) such that the correct circuit breakers open and no other circuit breaker opens.

## 6.14. Protection - Incorrect Operation

The operation is incorrect if, while a fault is being cleared, a circuit breaker is opened which should not have opened or a circuit breaker remains closed which should have opened.

## 6.15. PUTT

Permissive underreach transfer trip. A distance teleprotection scheme that allows accelerated tripping by receiving a signal for a fault in a relay's forward direction.

## 6.16. Sustained Interruption

A sustained interruption is one which lasts for more than one minute.

## 6.17. System Fault

Any fault or system abnormality which involves or is the result of failure of primary electrical apparatus and which requires the disconnection of the affected equipment from the system by the automatic tripping of the associated circuit breaker.

## 6.18. System Minute

A measure of the energy not supplied for a disturbance. The metric takes account of the load lost (MW), duration of disconnection (Minutes) and peak system demand (MW), to allow for historical comparison. For example, if 300 MW were lost for 10 minutes and the system peak was 3000 MW, this would represent one System Minute.

$$\text{System Minutes} = \frac{(\text{Load MW} \times \text{Duration mins})}{(\text{System Peak MW})} = \frac{(300 \times 10)}{3000} = 1$$

## 6.19. Transient Fault

A fault is transient if the unit or component is undamaged and is restored to service through manual switching operations, or rapid automatic reclosure on overhead lines, without repair being performed, but possibly with on-site inspection.

## 6.20. Zone Clearance Ratio

The Zone Clearance Ratio is defined as the ratio of the number of short circuit faults not cleared in Zone 1 to the total number of short circuit faults per year. The more faults cleared in Zone 1, the quicker they are taken off the power system which reduces the risk of system instability, plant damage and injury to personnel.

## 6.21. Zones of Protection

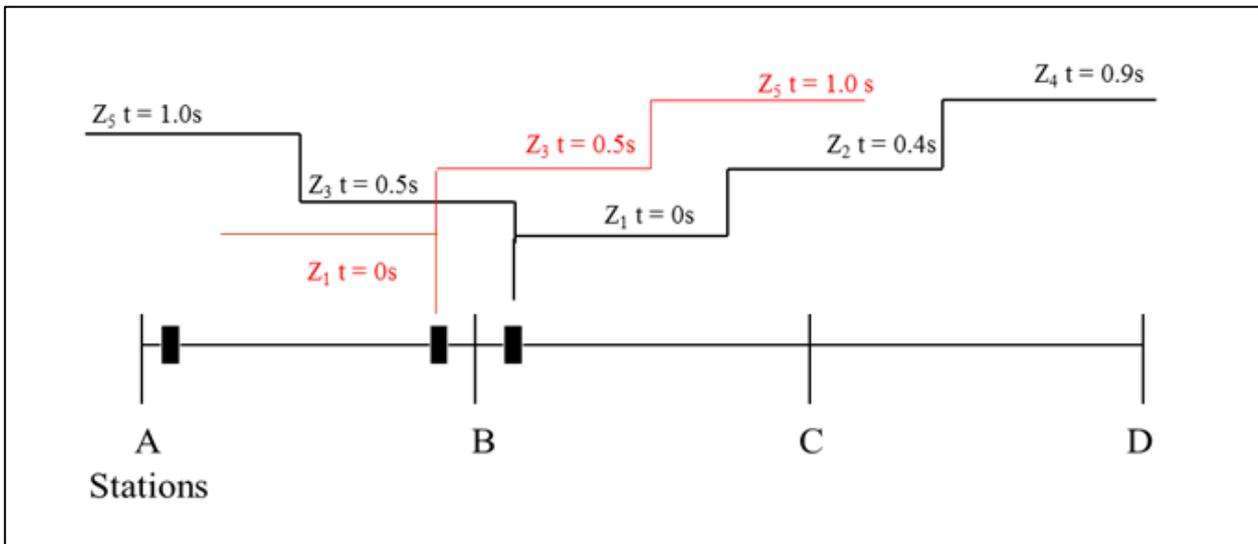


Figure 32: Zones of Protection

Zone 1 on an impedance (distance) relay is the primary protection zone and in the case of an overhead line is set to 70 - 85% of the circuit length depending on the location of the circuit in the transmission network. There is no time delay for the relay to pick up when a fault occurs within the Zone 1 reach, as shown in Figure 32. Typical Zone 1 clearance times are 50 to 150 ms.

Zone 2 on an impedance relay is used as a backup protection zone and is set to 100% of the circuit length plus 20 - 50% of the length of the shortest feeder at the remote end of the protected circuit. A delay of approximately 400 ms is applied in Zone 2 settings and so typical Zone 2 fault clearance times are 450 to 550 ms.

Zone 3 on an impedance relay is used as a backup protection zone and is set to 20 - 50% of the length of the shortest feeder in the reverse direction. A delay of approximately 500 ms is applied in Zone 3 settings and so typical Zone 3 fault clearance times are 550 to 650 ms.

Zone 4 is the third forward step of a distance scheme with a time delay of approximately 900 ms.

Zone 5 is the second reverse step of a distance protection scheme with a time delay of approximately 1.1 seconds.

# 7. Appendix 2 All Island Dispatchable Generation Plant

Table 10: All Island Dispatchable Generation Plant

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
AC Automation	ACA	7.6	DSU	75
Enel X	AE1	86.674	DSU	16.07
	AE2	12.464	DSU	31.71
	AE3	13.969	DSU	47.50
	AE4	15.096	DSU	8.02
	AE5	15.300	DSU	0.00
	EN1	15.451	DSU	10.94
	EN2	16.298	DSU	7.59
	EN3	16.330	DSU	28.46
	EN4	15.700	DSU	21.42
	EN5	5.840	DSU	2.74
	EN6	10.652	DSU	19.90
	EN8	23.350	DSU	33.36
	EN9	15.918	DSU	41.49
	EX1	20.200	DSU	4.76
Activation Energy Ltd (NI)	AEA	8.4	DSU	40.8
EPUK	Ballylumford - B10	101.000	Gas / Distillate Oil	88.7
	Ballylumford - B31	247.000	Gas / Distillate Oil	92.0

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
	Ballylumford - B32	247.000	Gas / Distillate Oil	93.1
	Ballylumford - BGT1	58.000	Distillate Oil	33.6
	Ballylumford - BGT2	58.000	Distillate Oil	94.6
	Kilroot - KPS1	256.000	Oil/Coal	60.9
	Kilroot - KPS2	258.000	Oil/Coal	37.0
	Kilroot - KGT1	30.000	Distillate Oil	93.8
	Kilroot - KGT2	30.000	Distillate Oil	86.9
	Kilroot - KGT3	42.000	Distillate Oil	81.5
	Kilroot - KGT4	42.000	Distillate Oil	78.9
	Kilroot Energy Storage Array	10.000 (5.000 MWh)	Battery	
Aughinish Alumina Ltd	Seal Rock - SK3	83.000	Gas / Distillate Oil	88.7
	Seal Rock - SK4	83.000	Gas / Distillate Oil	89.5
Bord Gáis	Whitegate - WG1	444.000	Gas / Distillate Oil	91.2
Contour Global	CGA	12.084	Gas	80.1
Coolkeeragh ESB	Coolkeeragh - C30	425.000	Gas / Distillate Oil	86.7
	Coolkeeragh - CG8	53.000	Distillate Oil	96.4
DAE Virtual Power Plant	DP1	4.530	DSU	27.65
	DP2	29.058	DSU	24.23
	DP3	8.413	DSU	4.30
Dublin Waste to Energy	Dublin Waste - DW1	62.000	Waste	88.9
Edenderry Power Ltd	Edenderry - ED1	118.000	Peat/Biomass	69.6

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
	Edenderry - ED3	58.000	Distillate Oil	98.0
	Edenderry - ED5	58.000	Distillate Oil	99.2
Electricity Exchange NI	VN1	6.8	DSU	3.5
Electric Ireland DSU	EI1	16.159	DSU	32.79
VIOTAS	EE1	64.283	DSU	26.00
	EE2	29.132	DSU	20.47
	EE3	10.306	DSU	14.45
	EE4	12.386	DSU	7.44
	EE5	16.911	DSU	53.63
	EE6	13.718	DSU	38.30
	EE7	6.107	DSU	41.49
	EE8	11.552	DSU	7.77
	EE9	10.806	DSU	24.47
Empower	EMP	12.755	Distillate Oil	96.5
Endeco Technologies	EC1	51.730	DSU	25.71
	EC2	11.950	DSU	29.03
	EC3	4.544	DSU	36.47
	EC4	4.736	DSU	52.18
	EC5	20.082	DSU	30.67
	ECA	21.8	DSU	29.5
	ECB	6.3	DSU	4.7
Energy Trading Ireland	ETB	5	DSU	14.5
	ETC	4.5	DSU	0
	ETD	5.1	DSU	2.4

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
	ETR	4.0	DSU	13.6
	ET1	4.667	DSU	18.00
Evermore Renewable Energy	Lisahally - LPS	18.000	Biomass	79.7
Indaver	IW1	17.000	Waste	91.8
IPOWER	AGU	57.717	Distillate Oil	86.3
	ID1	4.7	DSU	20.0
	ID2	5.2	DSU	25.1
Powerhouse Generation Ltd.	PG1	9.264	DSU	27.59
Powerhouse Generation Ltd. (NI)	PH1	19.5	DSU	29.5
	PH2	13.5	DSU	30.8
SSE Generation Ireland	Great Island - GI4	464.000	Gas / Distillate Oil	48.3
	Rhode - RP1	52.000	Distillate Oil	91.9
	Rhode - RP2	52.000	Distillate Oil	95.1
	Tarbert - TB1	54.000	Heavy Fuel Oil	0.0
	Tarbert - TB2	54.000	Heavy Fuel Oil	0.0
	Tarbert - TB3	241.000	Heavy Fuel Oil	56.8
	Tarbert - TB4	241.000	Heavy Fuel Oil	0.0
	Tawnaghmore - TP1	52.000	Distillate Oil	96.1
	Tawnaghmore - TP3	52.000	Distillate Oil	88.3
SYNERGEN	Dublin Bay - DB1	415.000	Gas / Distillate Oil	72.2
Tynagh Energy Ltd	Tynagh - TYC	404.000	Gas / Distillate Oil	86.6

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
Viridian Power and Energy	Huntstown - HN2	402.000	Gas / Distillate Oil	96.4
	Huntstown - HNC	342.000	Gas / Distillate Oil	90.1
ESB Power Generation	Ardnacrusha - AA1	21.000	Hydro	96.1
	Ardnacrusha - AA2	22.000	Hydro	95.6
	Ardnacrusha - AA3	19.000	Hydro	97.6
	Ardnacrusha - AA4	24.000	Hydro	11.5
	Aghada - AD2	449.000	Gas / Distillate Oil	75.5
	Aghada - AT11	90.000	Gas / Distillate Oil	96.6
	Aghada - AT12	90.000	Gas / Distillate Oil	95.4
	Aghada - AT14	90.000	Gas / Distillate Oil	98.1
	Erne - ER1	10.000	Hydro	96.7
	Erne - ER2	10.000	Hydro	93.2
	Erne - ER3	22.500	Hydro	98.8
	Erne - ER4	22.500	Hydro	98.4
	Lee - LE1	15.000	Hydro	95.9
	Lee - LE2	4.000	Hydro	77.3
	Lee - LE3	8.000	Hydro	96.0
	Liffey - LI1	15.000	Hydro	34.4
	Liffey - LI2	15.000	Hydro	94.7
	Liffey - LI4	4.000	Hydro	99.5
	Liffey - LI5	4.000	Hydro	75.2

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
	Moneypoint - MP1	285.000	Coal / Heavy Fuel Oil	77.0
	Moneypoint - MP2	285.000	Heavy Fuel Oil	26.6
	Moneypoint - MP3	285.000	Coal / Heavy Fuel Oil	71.5
	Poolbeg - PBA	232.000	Gas / Distillate Oil	93.6
	Poolbeg - PBB	232.000	Gas / Distillate Oil	92.7
	Turlough Hill - TH1	73.000	Hydro - Pumped Storage	84.3
	Turlough Hill - TH2	73.000	Hydro - Pumped Storage	79.9
	Turlough Hill - TH3	73.000	Hydro - Pumped Storage	78.4
	Turlough Hill - TH4	73.000	Hydro - Pumped Storage	80.8
Low Carbon	Drumkee - DK1	50.000 (21.600 MWh)	Battery	N/A
	Mullavilly - MZ1	50.000 (21.600 MWh)	Battery	N/A
	Connor - CSB	50.000 (21.600 MWh)	Battery	N/A
	Lisnabreeny - KEB	50.000 (21.600 MWh)	Battery	N/A
	Porterstown - PN1	30.000 (27.000 MWh)	Battery	N/A
Statkraft	Beenanaspuck and Tobertoreen - XT2	11.000 (5.660 MWh)	Battery	N/A
	Kelwin - KZ4	26.600 (13.400 MWh)	Battery	N/A
Lumcloon Energy	Lumcloon - LU1	50.000 (30.000 MWh)	Battery	N/A

Company	Unit	Capacity (MW)	Fuel	365-day Rolling Availability %
	Lumcloon - LU2	50.000 (30.000 MWh)	Battery	N/A
	Shannonbridge - SI1	50.000 (30.000 MWh)	Battery	N/A
	Shannonbridge - SI2	50.000 (30.000 MWh)	Battery	N/A
NTR	Gorey - OD1	9.000 (4.500 MWh)	Battery	N/A
Killala Community Wind Farm	Killala - KF2	10.800 (10.800 MWh)	Battery	N/A
ESB	Aghada - AD3	19.000 (38.000 MWh)	Battery	N/A
	Kylemore - IH1	30.000 (60.000 MWh)	Battery	N/A
Scottish Power	Gorman - GF1	50.000 (28.250 MWh)	Battery	N/A
	Golagh - GO2	3.000 (1.500 MWh)	Battery	N/A
Innogy/RWE	Lisdrumdoagh - LF1	60.000 (X.XXX MWh)	Battery	N/A
	Gardnershill - GP1	8.500 (9.580 MWh)	Battery	N/A
NTR	Avonbeg - AV1	16.000 (9.22 MWh)	Battery	N/A

# 8. Appendix 3 EirGrid Maintenance

## Policy Terms

The following summarises the main terms and activities in the asset maintenance policy as operated by EirGrid<sup>8</sup>. The overall objective of maintenance is to ensure that the assets continue to meet their service and performance requirements including safety, environmental and output parameters<sup>9</sup>. Maintenance activities help to realise expected lifetime of an asset.

There are four primary maintenance categories:

1. Preventative/Routine: Preventive/routine maintenance is planned at predetermined intervals to reduce the likelihood of equipment degradation which could lead to plant failure e.g., condition assessment. This type of maintenance is planned in advance and the frequencies of these activities are pre-determined by the EirGrid Asset Maintenance Policy
2. Corrective: Corrective maintenance may consist of repair, restoration, or replacement of equipment before functional failure. Corrective maintenance requirements are identified through regular inspections. The aim of routine inspections is to identify the potential for failure in time for the solution to be planned and scheduled and then performed during the next available outage.
3. Fault: Fault maintenance includes activities arising from unexpected equipment failure in service.
4. Statutory Maintenance: Maintenance which is carried out to facilitate statutory requirements e.g., Pressure Vessel Inspections, bund inspections.

Please refer to the 'Guide to Transmission Equipment Maintenance' which is published on the EirGrid website for further information<sup>10</sup>.

---

<sup>8</sup> In Northern Ireland maintenance policy for the transmission system is the responsibility of NIE Networks as licenced Transmission Owner.

<sup>9</sup> An anatomy of Asset Management - Institute of Asset Management Version 2 (July 2014)

<sup>10</sup> [www.eirgridgroup.com/site-files/library/EirGrid/Guide-to-Transmission-Equipment-Maintenance-March-2019.pdf](http://www.eirgridgroup.com/site-files/library/EirGrid/Guide-to-Transmission-Equipment-Maintenance-March-2019.pdf)

# 9. Appendix 4 Formulae

## 9.1. Ireland Availability & Unavailability Formula

*Availability of 110kV, 220 kV, 275 kV and 400 kV lines:*

$$\text{System Availability} = 1 - \frac{\sum_{i=1}^{i=n} \text{Duration of Outage (i)} * \text{Length of Line (i)}}{\sum_{j=1}^{j=m} \text{Length of Line (j)} * \text{Days in a Year}}$$

Where: n = The total number of lines (at that voltage level) for which outages occurred

m = The total number of lines at that voltage level

*Availability of 220 kV/110 kV, 275 kV/220 kV and 400 kV/220 kV transformers:*

$$\text{System Availability} = 1 - \frac{\sum_{i=1}^{i=n} \text{Duration of Outage (i)} * \text{MVA of Transformer (i)}}{\sum_{j=1}^{j=m} \text{MVA of Transformer (j)} * \text{Days in a Year}}$$

Where: n = The total number of transformers for which outages occurred

m = The total number of transformers at that voltage level

*System Unavailability:*

$$\text{System Unavailability} = 1 - \frac{\sum \text{Hours each Circuit is Available}}{\text{Number of Circuits} * \text{Hours in Period}}$$

The equation above is the same as that used by OFGEM (The Office of Gas and Electricity Markets) in the UK.

## 9.2. System Minute Formula

System Minutes:

$$\text{System Minutes} = \frac{\text{Energy not supplied MW Minutes}}{\text{Power at System Peak}}$$

$$\text{System Minutes} = \frac{(\text{MVA Minutes}) * (\text{Power Factor})}{\text{System Peak to Date}}$$

Where Power Factor = 0.9.